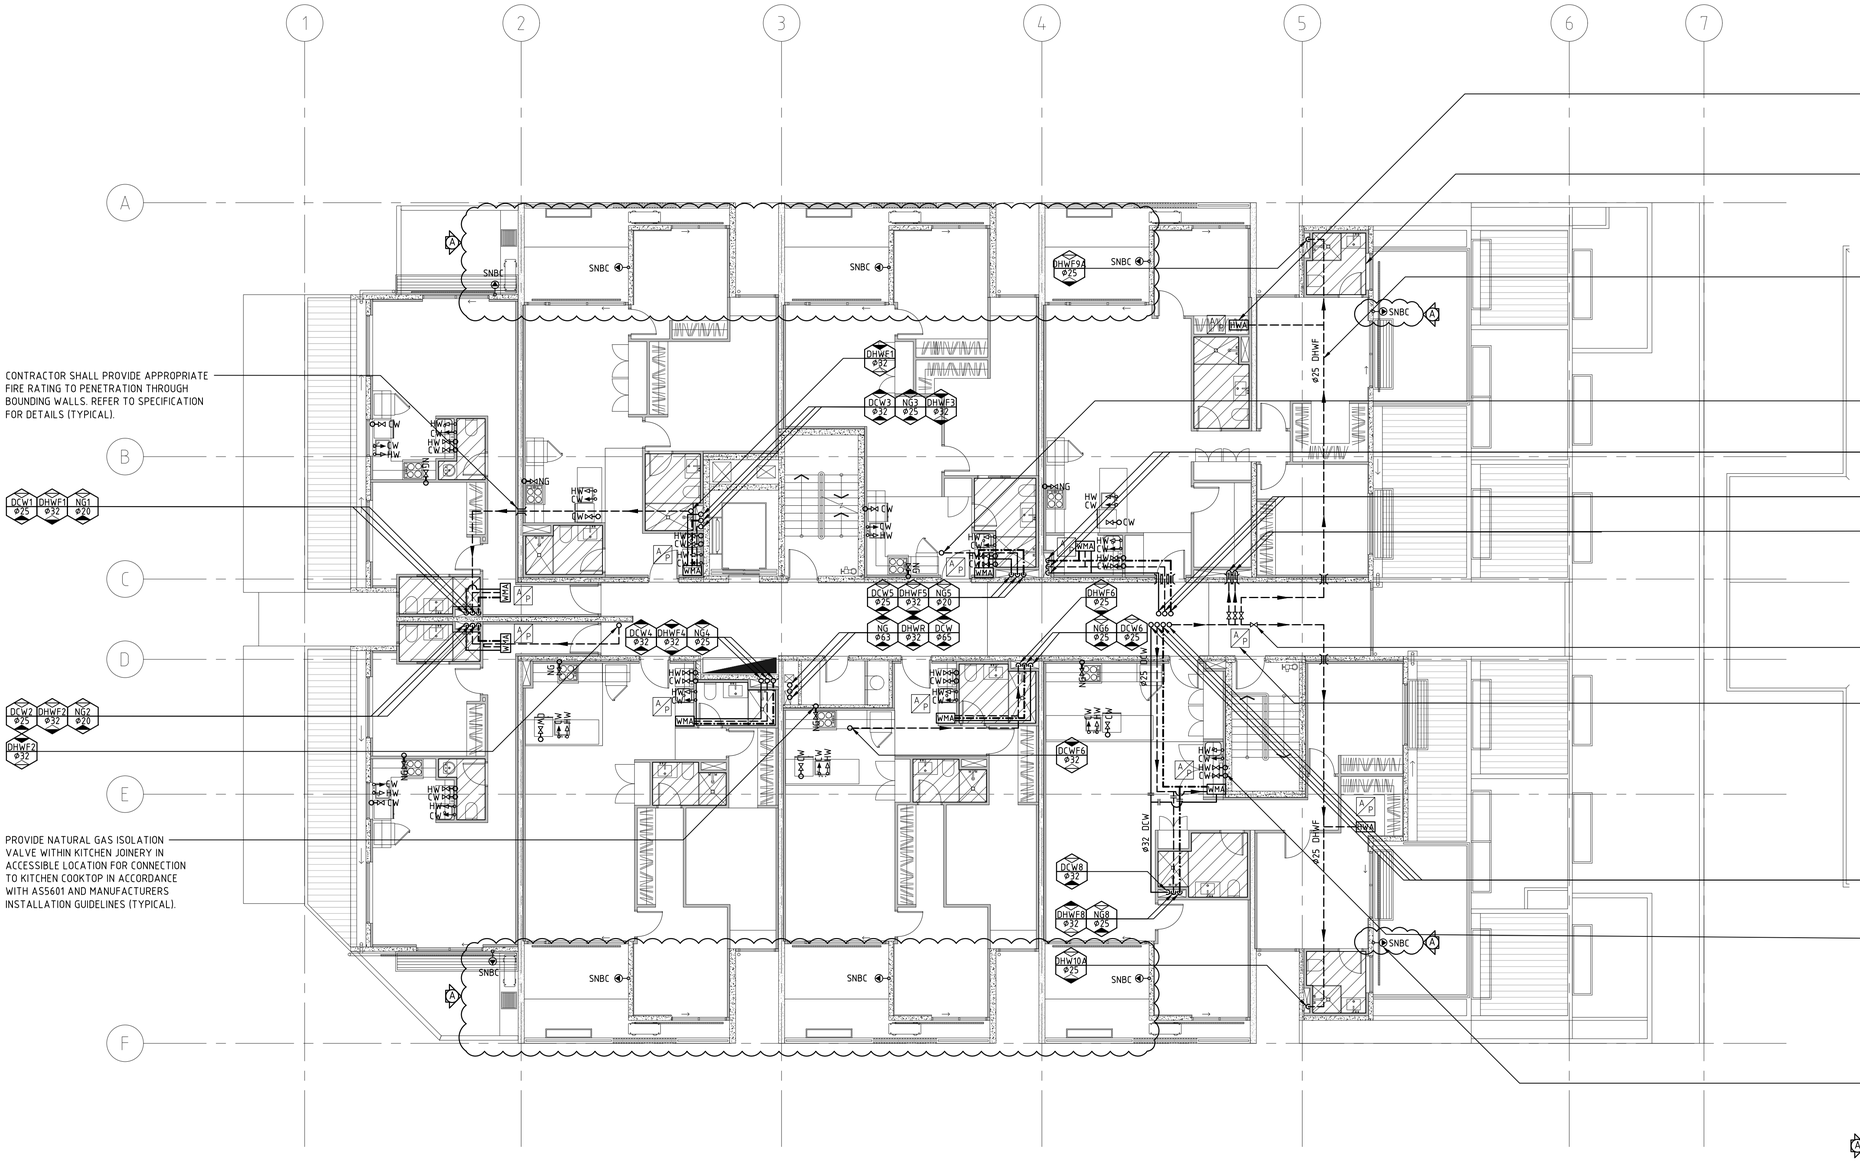

CONTRACTOR SHALL PROVIDE APPROPRIATE FIRE RATING TO PENETRATION THROUGH BOUNDING WALLS. REFER TO SPECIFICATION FOR DETAILS (TYPICAL).

PROVIDE NATURAL GAS ISOLATION VALVE WITHIN KITCHEN JOINERY IN ACCESSIBLE LOCATION FOR CONNECTION TO KITCHEN COOKTOP IN ACCORDANCE WITH AS5601 AND MANUFACTURERS INSTALLATION GUIDELINES (TYPICAL).

PROVIDE Ø20 HOT WATER METER AND VALVE ASSEMBLY FOR HOT WATER SUPPLY TO BATHROOM. ASSEMBLY TO CONSIST OF DHW ISOLATION VALVE, PULSE OUTPUT HOT WATER METER AND TEMPERING VALVE SET AT 50°C MAX FOR WARM WATER SUPPLY TO FIXTURES. REFER TO DETAIL ON DRAWING NUMBER 'LCE13523-H17' FOR FURTHER INFORMATION.

CROSSHATCH AREA INDICATES POD BATHROOM FOR APARTMENTS. POD TO BE CONSTRUCTED OFF SITE BY BUILDER COMPLETE WITH FIXTURES, TAPWARE, AND INTERNAL COLD AND HOT WATER SUPPLIES. CONTRACTOR SHALL LOCATE CAPPED DCW AND DHW SUPPLIES AT EDGE OF POD AND CONNECT TO APARTMENT INCOMING SUPPLY. REFER TO PART PLAN ON DRAWING NUMBER 'LCE13523-H17' FOR FURTHER INFORMATION (TYPICAL).

PROVIDE ACOUSTIC LAGGING TO ALL RETICULATION PIPEWORK RETICULATING WITHIN APARTMENT CEILING SPACES (TYPICAL).

PROVIDE ISOLATION VALVE AT TOP OF DHWF RISER IN CORRIDOR CEILING SPACE ADJACENT ACCESS PANEL (TYPICAL).

PROVIDE METER AND VALVE ASSEMBLY ON INCOMING Ø20 DCW, Ø25 NG AND Ø25 DHW SUPPLIES TO APARTMENT. ASSEMBLY TO CONSIST OF ISOLATION VALVES ON EACH SUPPLY. PULSE OUTPUT WATER METERS ON DCW AND DHW SUPPLIES AND TEMPERING VALVE FOR WARM WATER SUPPLY TO BATHROOM FIXTURES. LOCATE IN CEILING SPACE ADJACENT ACCESS PANEL AS SHOWN. REFER TO DETAIL ON DRAWING NUMBER 'LCE13523-H17' FOR FURTHER INFORMATION (TYPICAL).

PROVIDE Ø15 DCW AND Ø15 DHW STOPCOCKS BELOW TROUGH FOR CONNECTION TO WASHING MACHINE- SHOWN HERE FOR CLARITY. REFER TO DETAIL ON DRAWING NUMBER 'LCE13523-H17' FOR FURTHER INFORMATION.

A PROVIDE Ø20 SCREW NOSE BIBCOCK SET AT 750 AFFL COMPLETE WITH HOSE CONNECTOR SYPHON BREAKER. EXTEND Ø20 DCW SUPPLY FROM APARTMENT SUPPLY DOWNSTREAM OF METER IN ACCORDANCE WITH AS/NZS3500 (TYPICAL).

CONSTRUCTION ISSUE

REV'N	DESCRIPTION	DATE	CHK'D
A	CONSTRUCTION ISSUE	21.09.18	AS

LUCID
CONSULTING AUSTRALIA
Level 3/169 Pirie St Adelaide SA 5000
Phone: (08) 8407 9700
Email: adelaide@lucidconsulting.com.au

CLIENT
CITIFY
bfc

PROJECT
THE WILLCOX APARTMENTS
117 PROSPECT ROAD, PROSPECT

DRAWING
LEVEL 3 WATER AND GAS RETICULATION ARRANGEMENT

HYDRAULIC SERVICES

SCALE	DATE		
1:100@A1	SEPTEMBER 2018		
	DESIGNED	DRAWN	No. IN SET
	JZ	JZ/OD	13 OF 17
	DRAWING NUMBER		REVISION
	LCE13523-H13		A