



Ground Floor
1 : 100

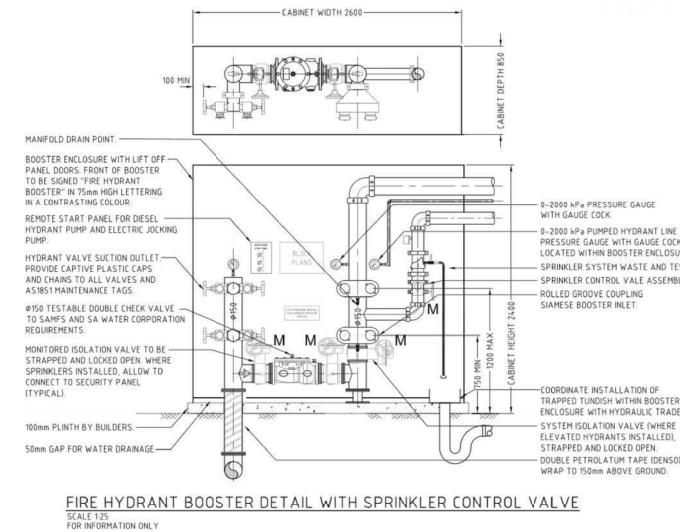

DESIGN BASIS:
Wet fire design in accordance with Australian Standard 2118 1999 - Automatic Fire sprinkler systems.
General requirements.
Ordinary hazard group II CARPARK. 5 mm/min over 144 m²



FORGE FIRE SERVICES PTY LTD EXPRESSLY RESERVES THE COPYRIGHT IN THIS DRAWING AND THE WORK THE SUBJECT OF THIS DRAWING. THE DRAWING AND THE WORK THE SUBJECT OF THE DRAWING CANNOT BE USED FOR ANY PURPOSES OTHER THAN AS A RECORD OF THE WORKS PERFORMED BY FORGE FIRE SERVICES PTY LTD. NO RIGHT OR LICENCE IS GRANTED TO REPRODUCE OR OTHERWISE DEAL WITH THE COPYRIGHT IN THIS DRAWING.

REV	AMENDMENTS	DATE
A	ISSUED FOR REVIEW	03/03/2020

TITON
FIRE, SECURITY, ELECTRICAL SERVICES PTY LTD

4 Howards Road
Beverly SA 5009
Ph (08) 8244 8311 24hrs
Fax (08) 8244 8299
Email: admin@titonfire.com.au


FORGE

T (08) 7222 9605 E info@forgefire.com.au
PO Box 118, Brompton SA 5007 **FORGEFIRE.COM.AU**

PROJECT:
168 PROSPECT ROAD,
PROSPECT SA

DWG TITLE:
FIRE PROTECTION SERVICES
GROUND AND FIRST FLOOR

SCALE @ A1	BY	PLAN No.	REVISION
1 : 100	GS	FS-01	A

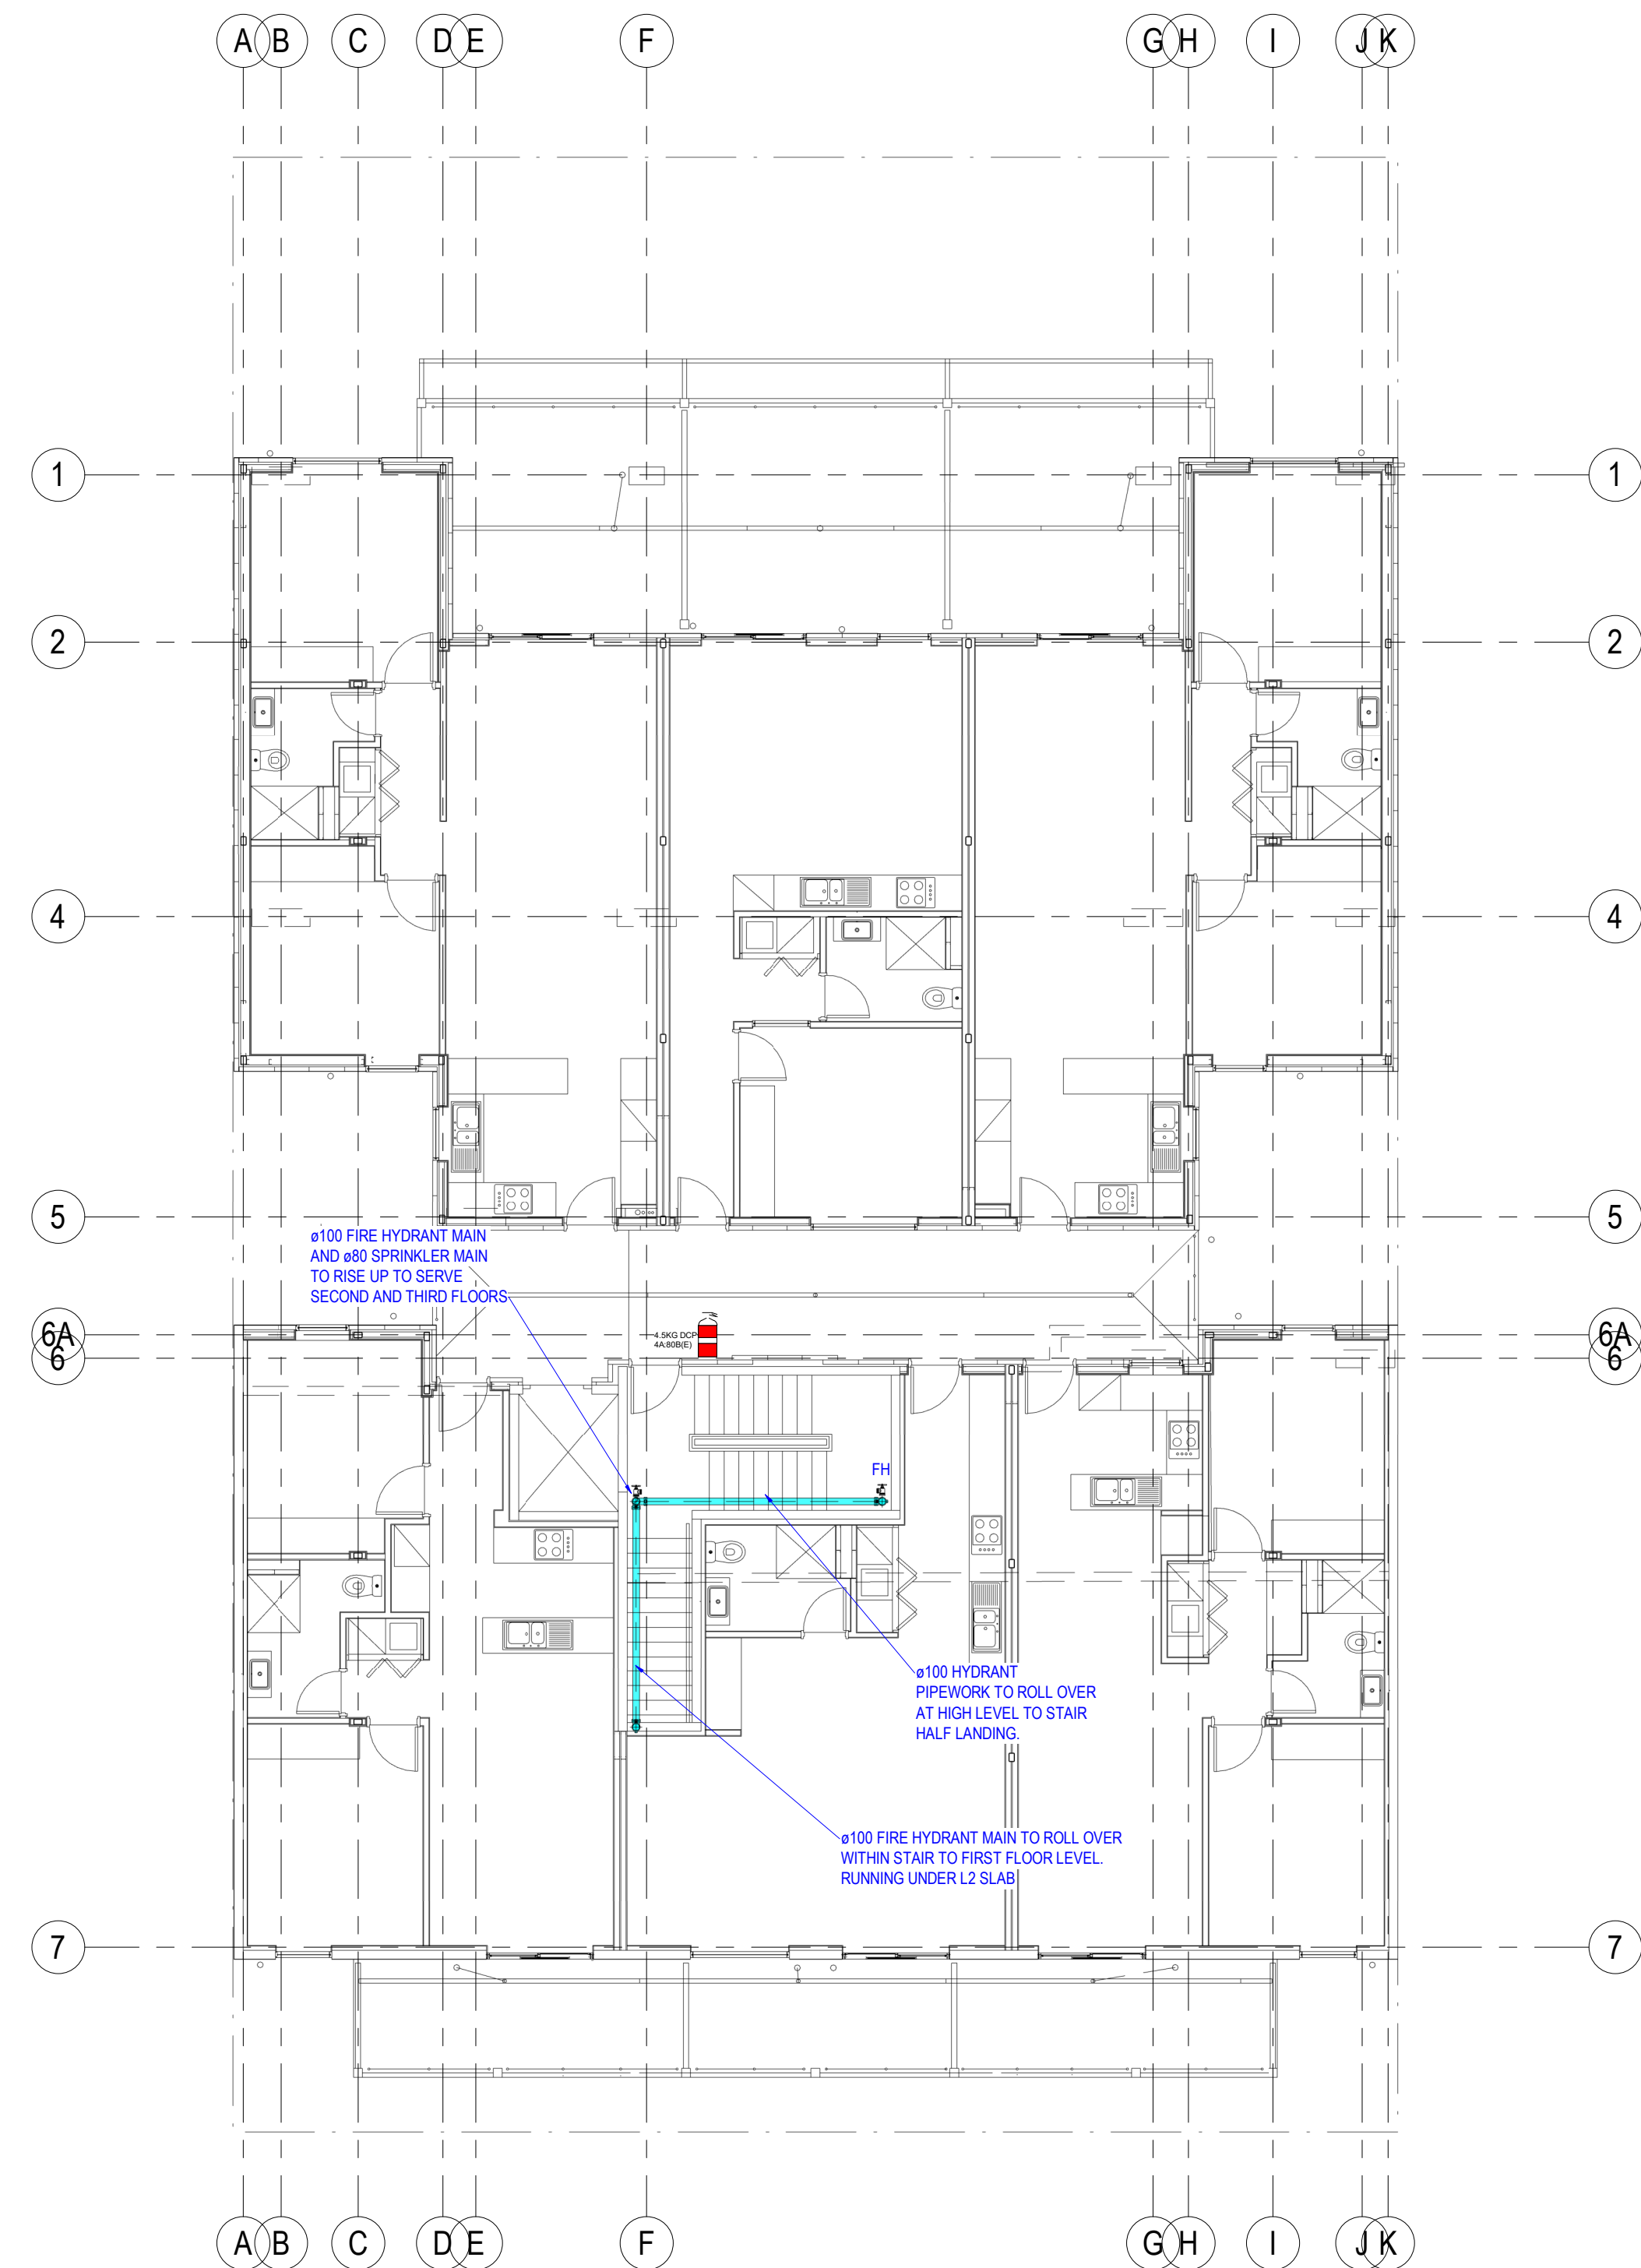

FIRST FLOOR
1 : 100