



NOTES:

- ALL COMMS CABLING SHALL BE RUN IN PVC CONDUIT IN WALL CAVITY BETWEEN OUTLETS AND CEILING SPACE (FOR FUTURE RE-WIRING).
- FOR ALL ACCESS WC FACILITIES, GENERAL PURPOSE OUTLETS SHALL BE LOCATED NOT LESS THAN 600mm NOR MORE THAN 1100mm ABOVE THE FINISHED FLOOR LEVEL AND NOT LESS THAN 500mm FROM INTERNAL CORNERS.
- MECHANICAL PLANT IN CEILING OF TENANCY TO BE SUPPLIED FROM TENANCY BOARDS.

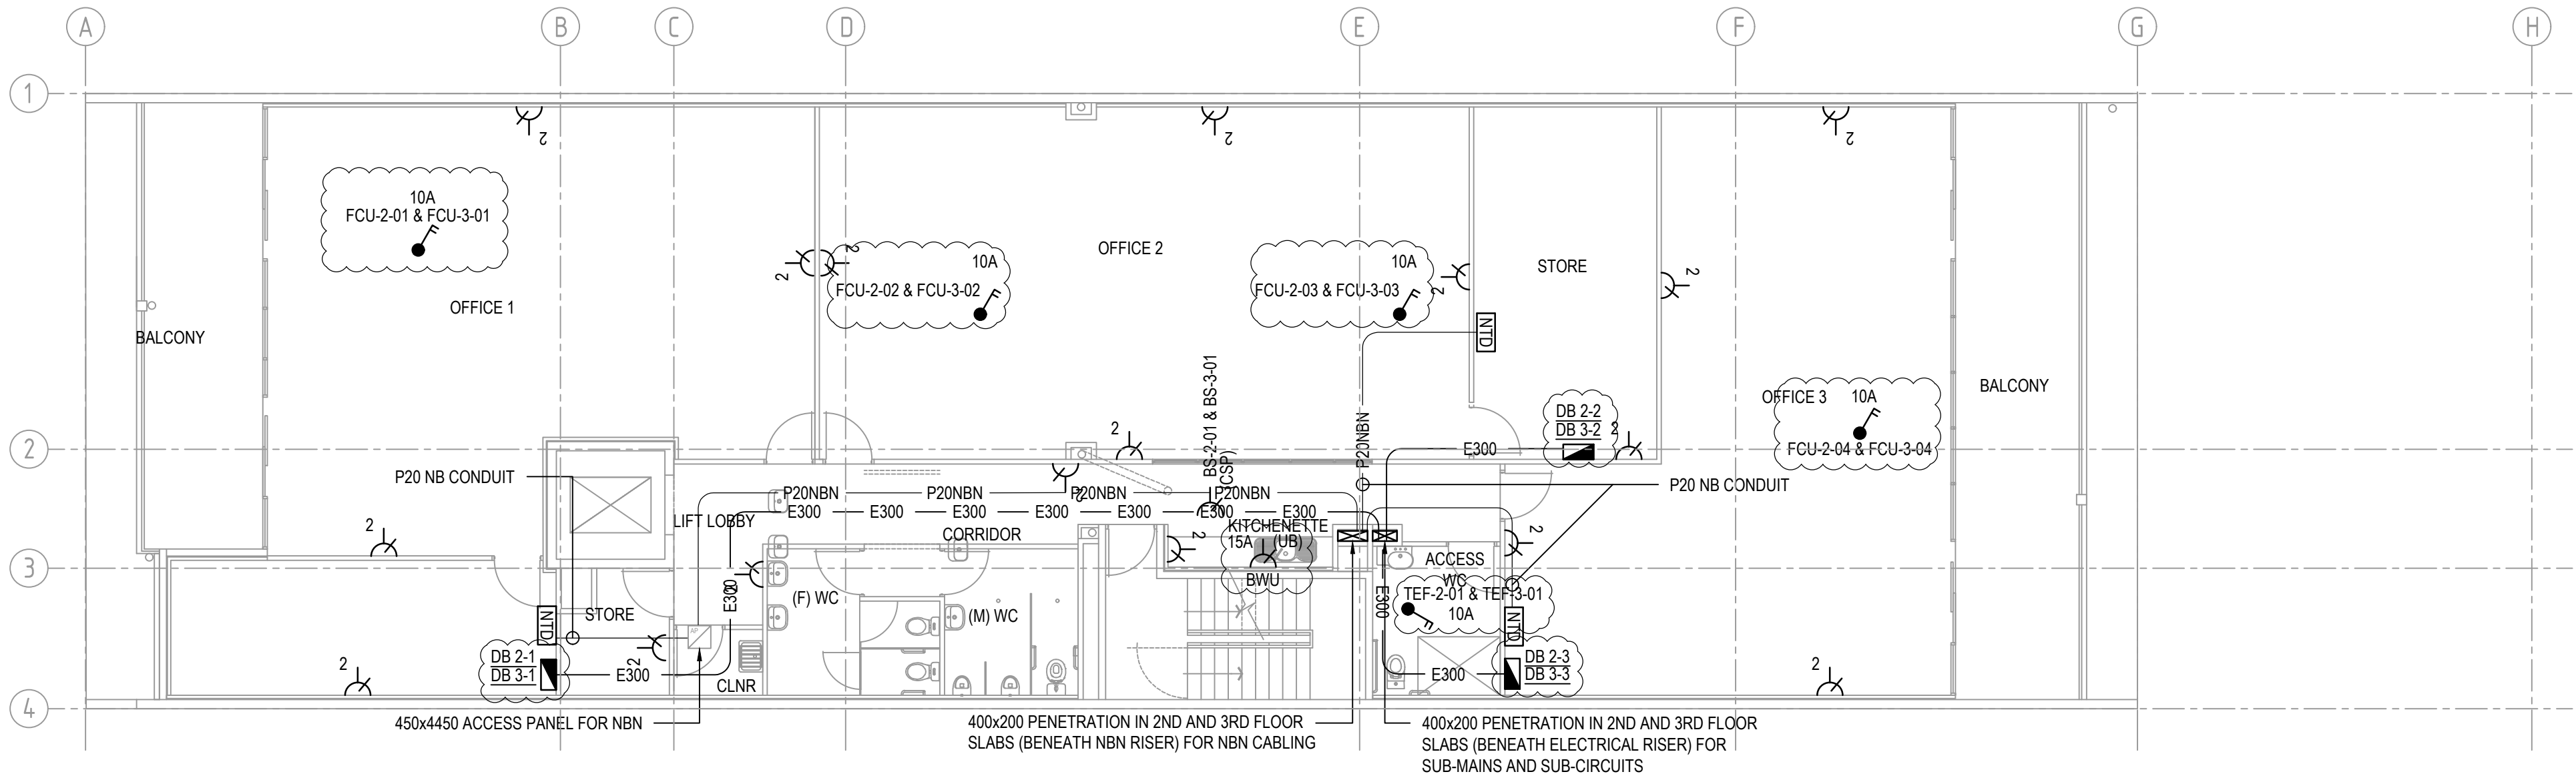

SECOND AND THIRD FLOOR PLAN  
SCALE 1:100

DRAWINGS TO BE READ IN CONJUNCTION  
WITH ELECTRICAL SPECIFICATION

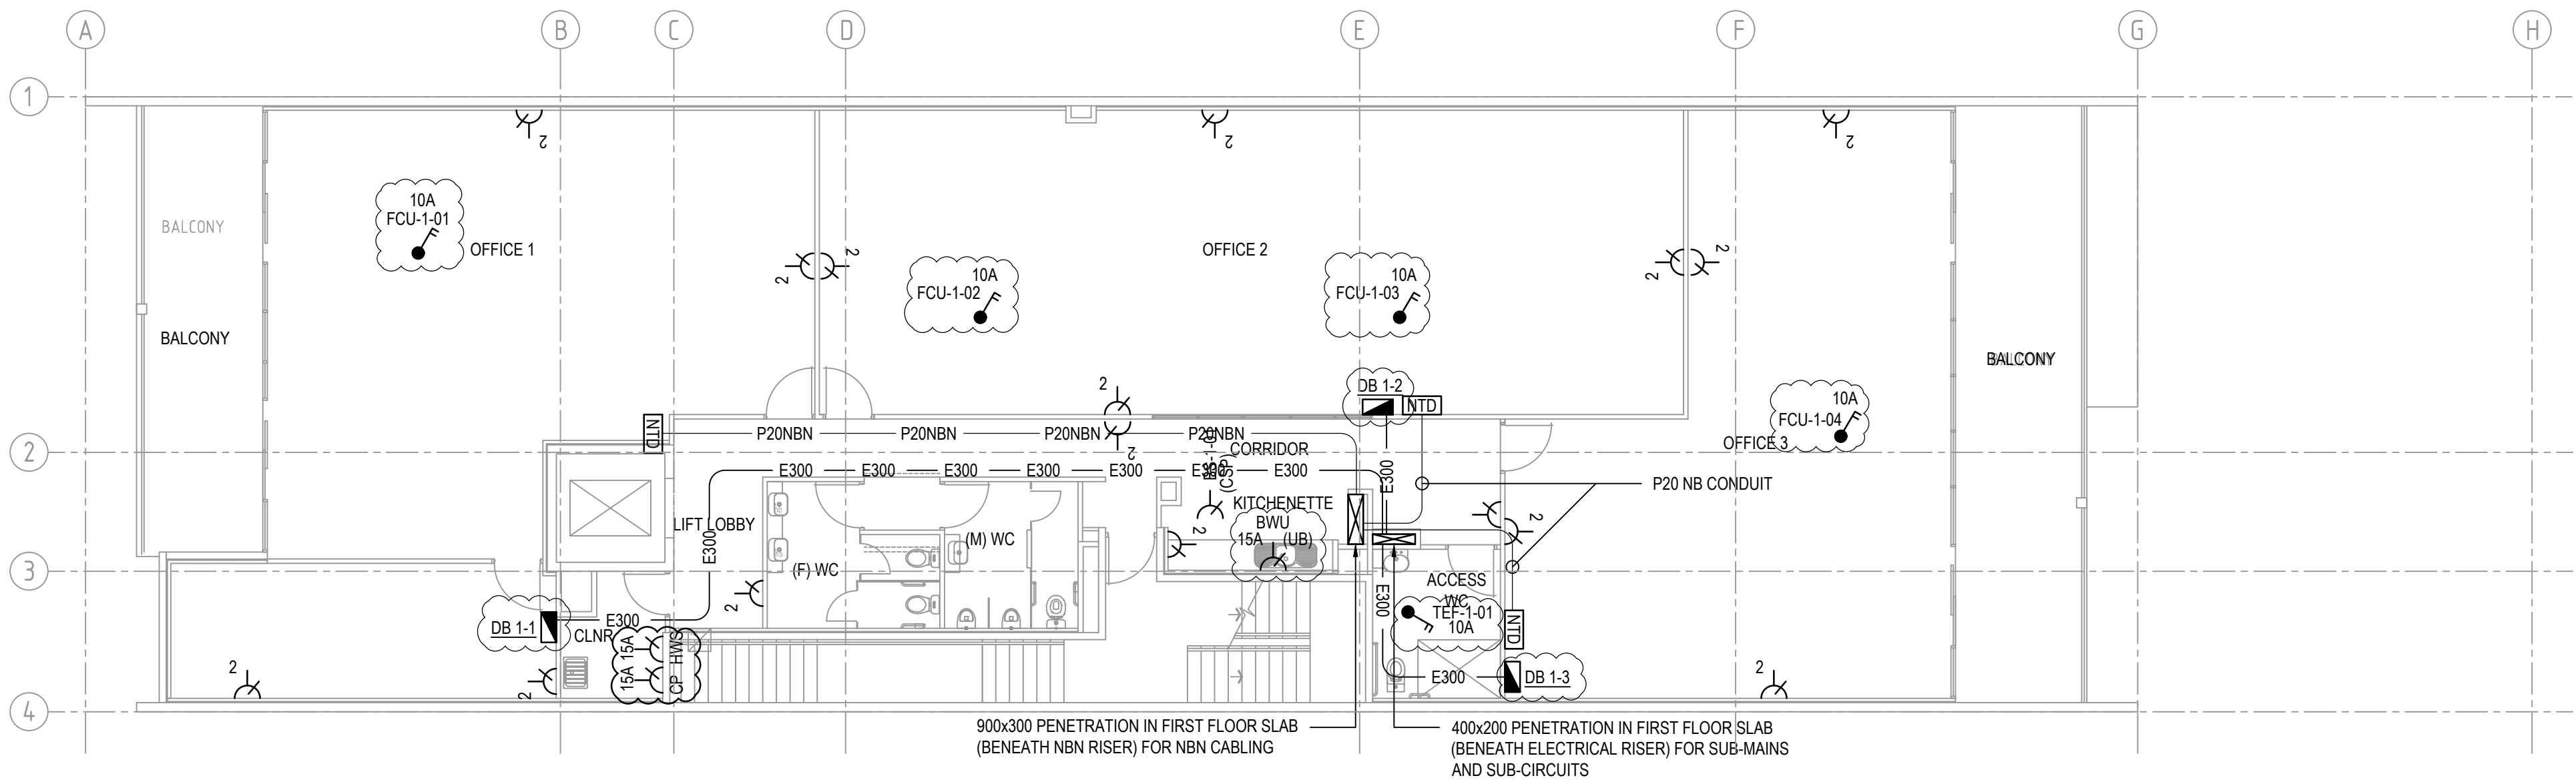

FIRST FLOOR PLAN  
SCALE 1:100

Rev	Date	Issue Description	By
A	21-11-18	TENDER ADDENDUM	PTK
-	27-08-18	TENDER ADDENDUM	PTK

Project  
PROPOSED COMMERCIAL  
DEVELOPMENT  
97 KING WILLIAM STREET  
KENT TOWN

Title  
ELECTRICAL SERVICES  
FIRST AND SECOND - THIRD FLOORS -  
POWER AND COMMS LAYOUT

Architect  
**ANTHONY DONATO ARCHITECTS**  
Suite 5/59 Fullarton Road | Kent Town SA 5087  
t. 08 8364 6888 | f. 08 8364 5355 | www.adarchitects.com.au

**SECON**  
consulting engineers  
456 PULTENEY STREET  
ADELAIDE  
SOUTH AUSTRALIA 5000  
TEL: 08 8223 7800  
engineers@secon.net.au  
A.B.N. 30 613 300 299  
A.C.N. 613 300 299

© COPYRIGHT SECON PTY. LTD. 2017			
North	DRAWN	CLB	CHECKED
	ENG	RB	Q.A.
DATE	MAR 18	SCALE	1:100 @ A1
		SHEET	2 OF 10
DRAWING No. <b>B8014-E02</b>			
PLOT DATE:	21/11/2018	Size	Rev.
		A1	A



TENDER