

NOTES:

- ALL COMMS CABLING SHALL BE RUN IN PVC CONDUIT IN WALL CAVITY BETWEEN OUTLETS AND CEILING SPACE (FOR FUTURE RE-WIRING).
- FOR ALL ACCESS WC FACILITIES, GENERAL PURPOSE OUTLETS SHALL BE LOCATED NOT LESS THAN 600mm NOR MORE THAN 1100mm ABOVE THE FINISHED FLOOR LEVEL AND NOT LESS THAN 500mm FROM INTERNAL CORNERS.

DRAWING LIST	
Drawing #	Description
E01	BASEMENT AND GROUND FLOORS - POWER AND COMMS LAYOUT
E02	FIRST AND SECOND-THIRD FLOORS - POWER AND COMMS LAYOUT
E03	ROOF PLAN - POWER LAYOUT
E04	BASEMENT AND GROUND FLOORS - LIGHTING LAYOUT
E05	FIRST AND SECOND-THIRD FLOORS - LIGHTING LAYOUT
E06	POWER DETAILS
E07	LIGHTING DETAILS
E08	LEGEND
E09	SINGLE LINE DIAGRAM
E10	SEISMIC DETAILS

PROVIDE COMMON TRENCH BETWEEN UNDERGROUND POWER AND COMMS SERVICES WHERE POSSIBLE

DRAWINGS TO BE READ IN CONJUNCTION WITH ELECTRICAL SPECIFICATION

REFER TO CIVIL SPECIFICATION FOR TRENCHING, COMPACTING, BACKFILLING AND SURFACE RE-INSTALLMENT REQUIREMENTS

1	22-06-18	BUILDING RULES CONSENT	CLB	
0	18-05-18	BUILDING RULES	CLB	
Rev	Date	Issue Description	By	

Project  
**PROPOSED COMMERCIAL DEVELOPMENT**  
97 KING WILLIAM STREET  
KENT TOWN

Title  
**ELECTRICAL SERVICES**  
BASEMENT AND GROUND FLOORS -  
POWER AND COMMS LAYOUT

Architect

**ANTHONY DONATO ARCHITECTS**

Suite 5/59 Fullarton Road | Kent Town SA 5087  
t: 08 8364 6888 | f: 08 8364 5355 | www.adarchitects.com.au

**SECON**  
consulting engineers


456 PULTENEY STREET  
ADELAIDE  
SOUTH AUSTRALIA 5000

TEL: 08 8223 7800  
engineers@secon.net.au  
A.B.N. 30 613 300 299  
A.C.N. 613 300 299


© COPYRIGHT SECON PTY. LTD. 2017			
	DRAWN	CLB	CHECKED
	ENG	RB	Q.A. AD
	DATE	MAR '18	SCALE 1:100 @ A1
		SHEET	1 OF X
DRAWING No. <b>B8014-E01</b>			
PLOT DATE: 22/06/2018		Size: <b>A1</b>	Rev: <b>1</b>



BUILDING RULES

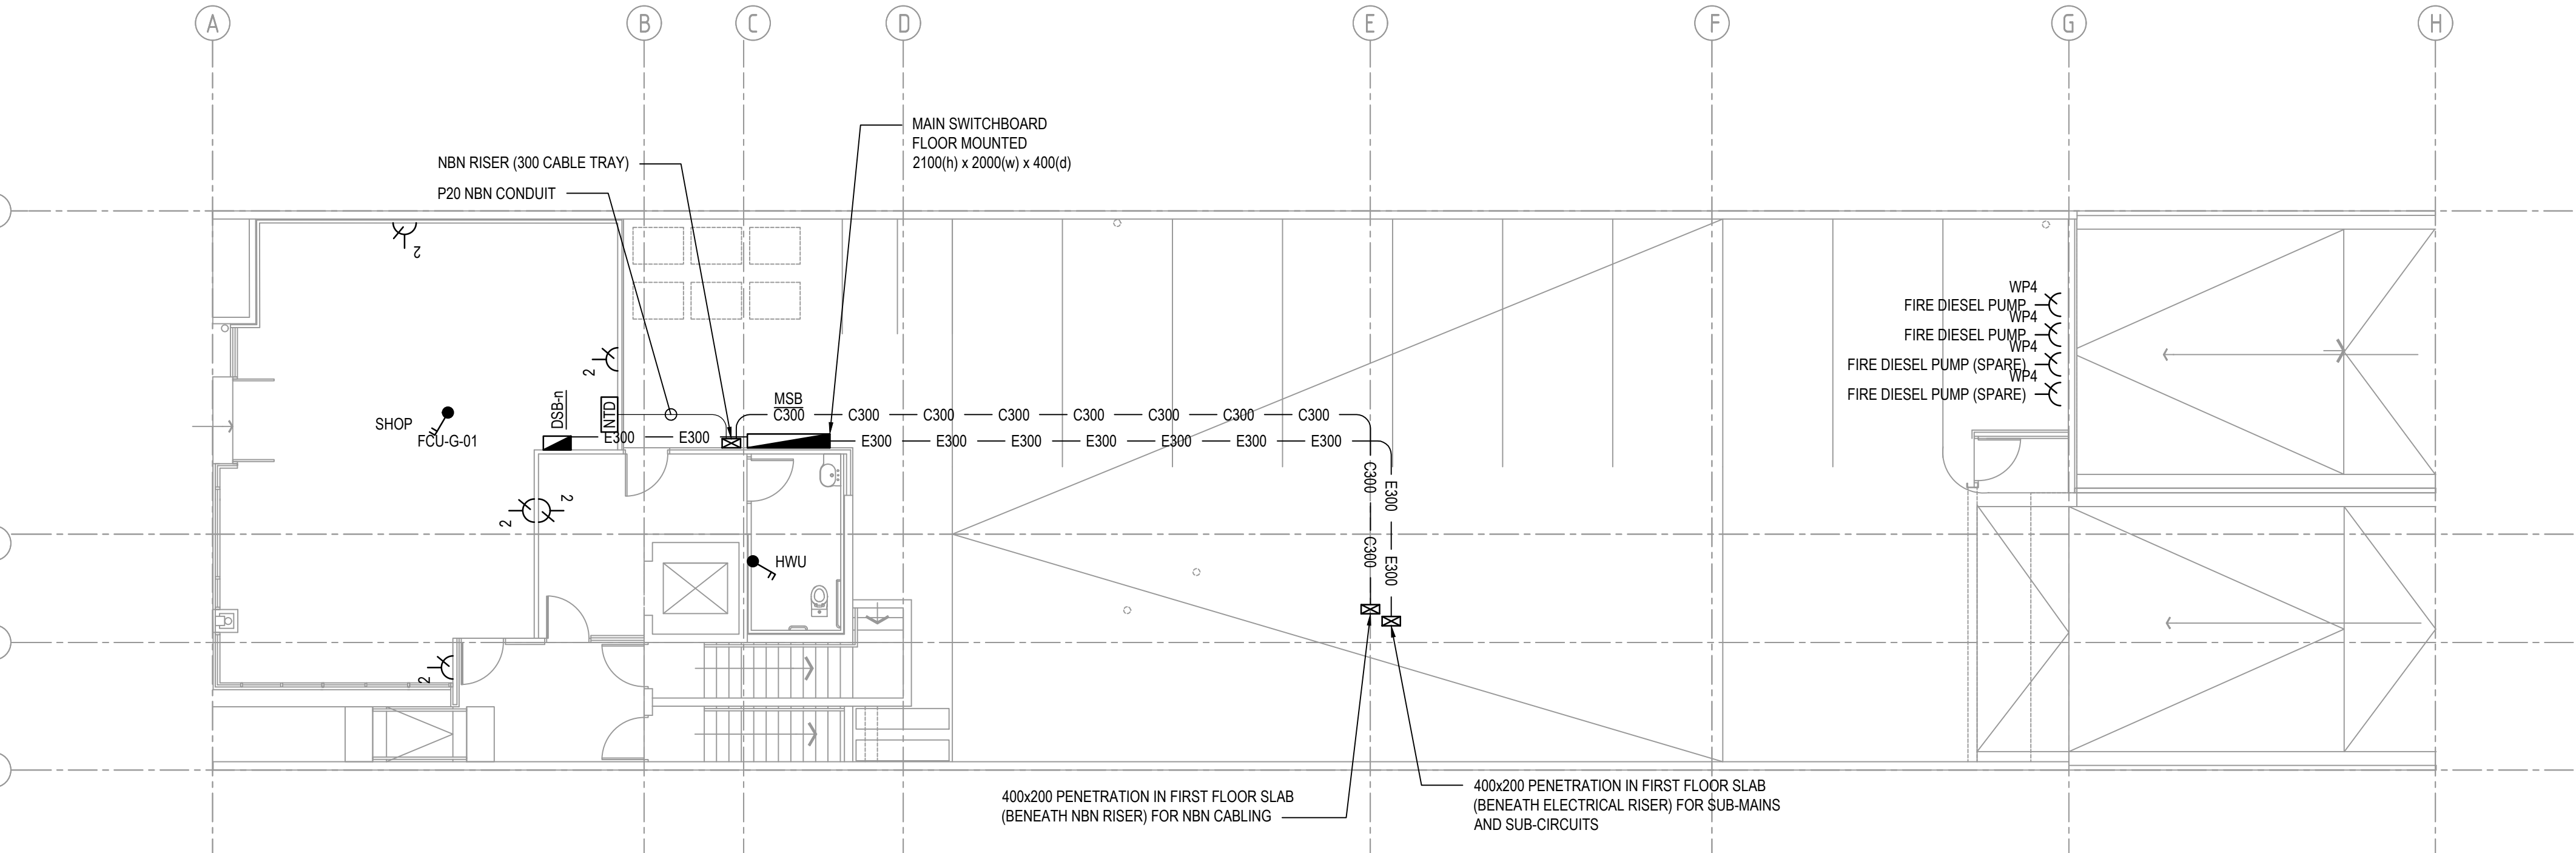

GROUND FLOOR PLAN  
SCALE 1:100

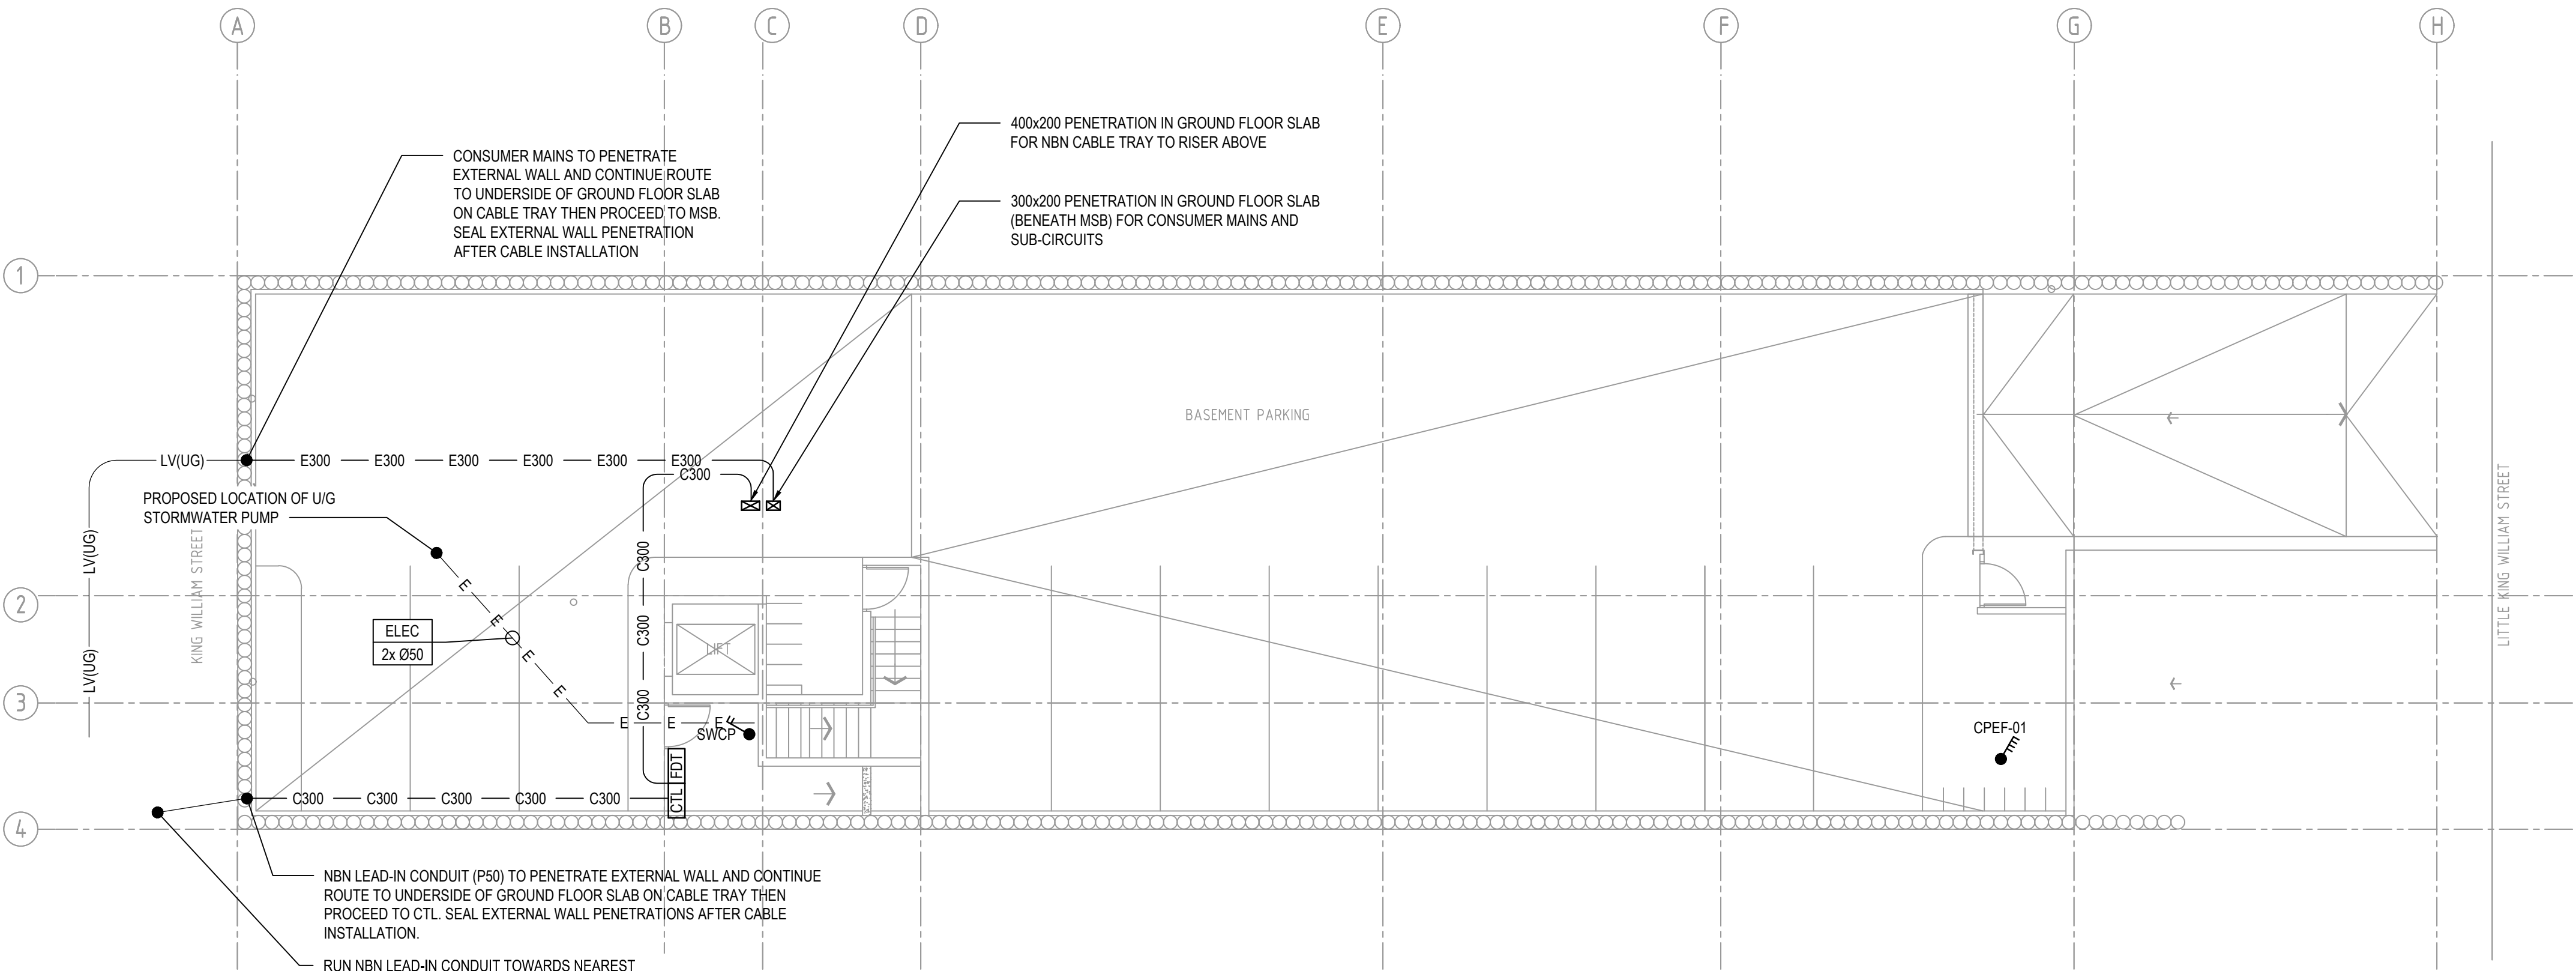

BASEMENT PLAN  
SCALE 1:100