


DIMENSIONS	CLEARANCE
A - CLEARANCE ABOVE LUMINAIRE	200 mm*
B - SIDE CLEARANCE TO COMBUSTIBLE BUILDING ELEMENT	200 mm*
C - SIDE CLEARANCE TO BULK THERMAL INSULATION	50 mm*
D - CLEARANCE TO AUXILIARY EQUIPMENT (TRANSFORMER FOR EXAMPLE)	50 mm*

* = DEFAULT MINIMUM CLEARANCES FOR RECESSED LUMINAIRES AS PER AS3000:2007 UNLESS SPECIFIED OTHERWISE BY LUMINAIRE MANUFACTURER

WARNING



Recessed lights have been installed in this roof space. To reduce the risk of fire DO NOT COVER the light fittings with thermal insulation or any other material unless in accordance with instructions provided by the light fitting or barrier manufacturer.

WARNING SIGN TO BE INSTALLED IN ACCESSIBLE ROOF SPACES CONTAINING RECESSED LUMINAIRES.

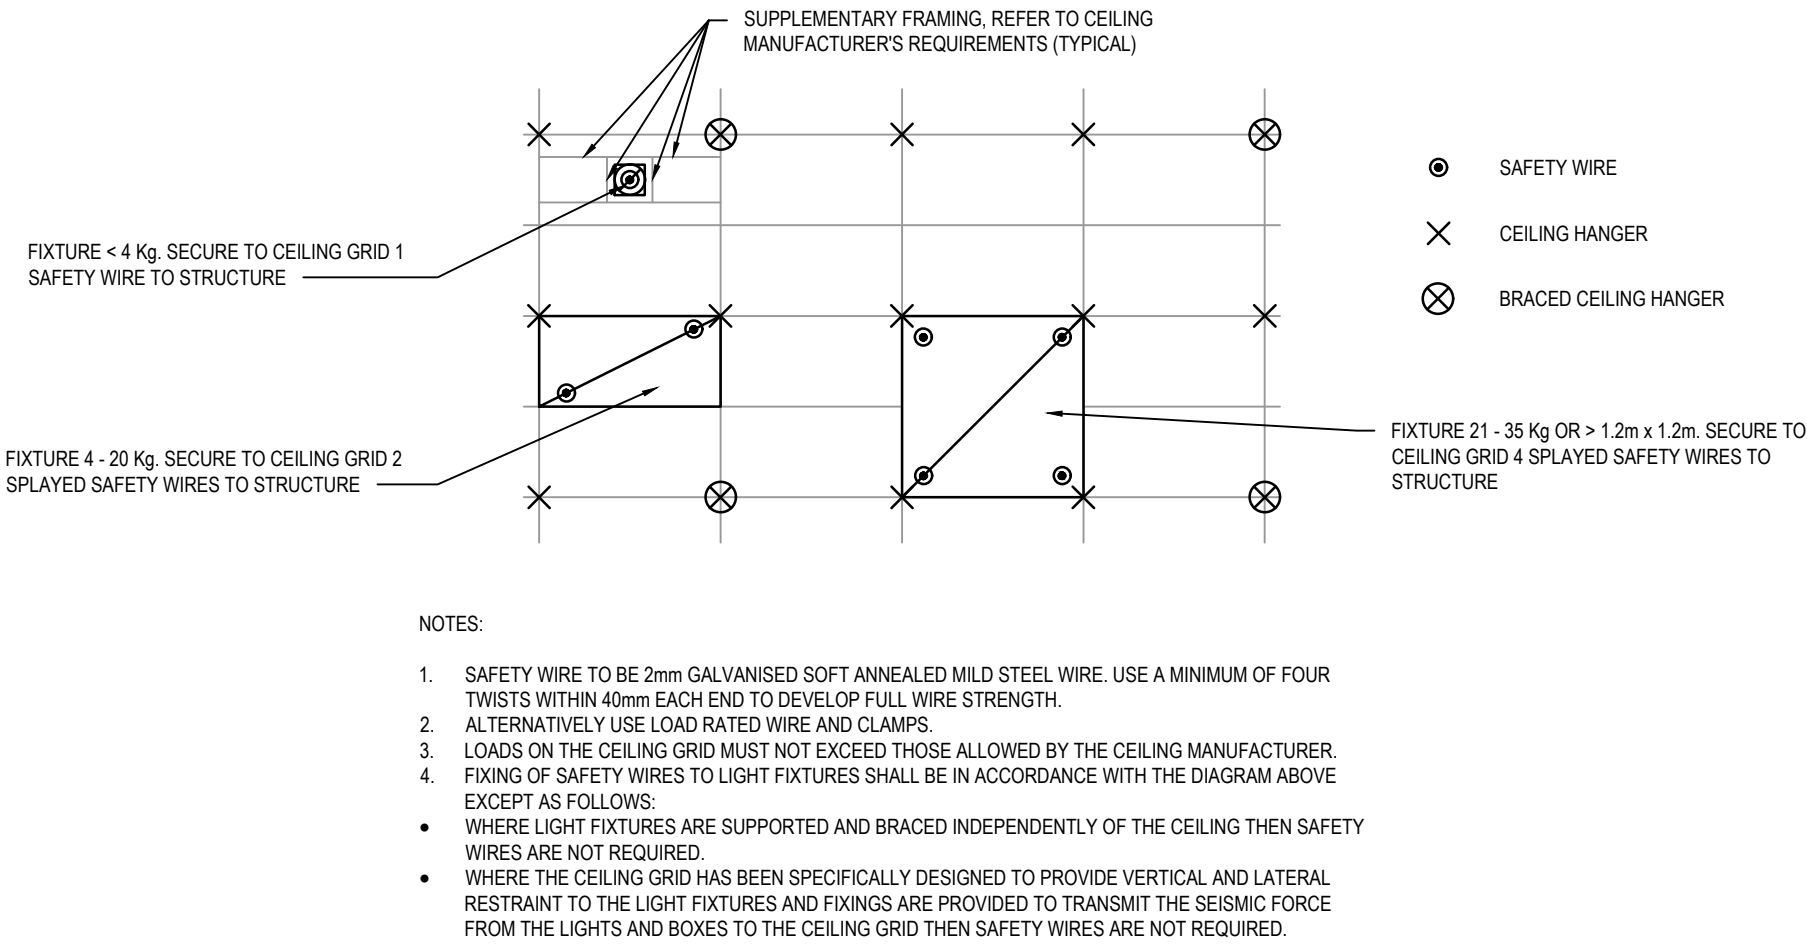

1 DEFAULT MINIMUM CLEARANCES FOR RECESSED LUMINAIRES


2 T-BAR LUMINAIRE FIXING

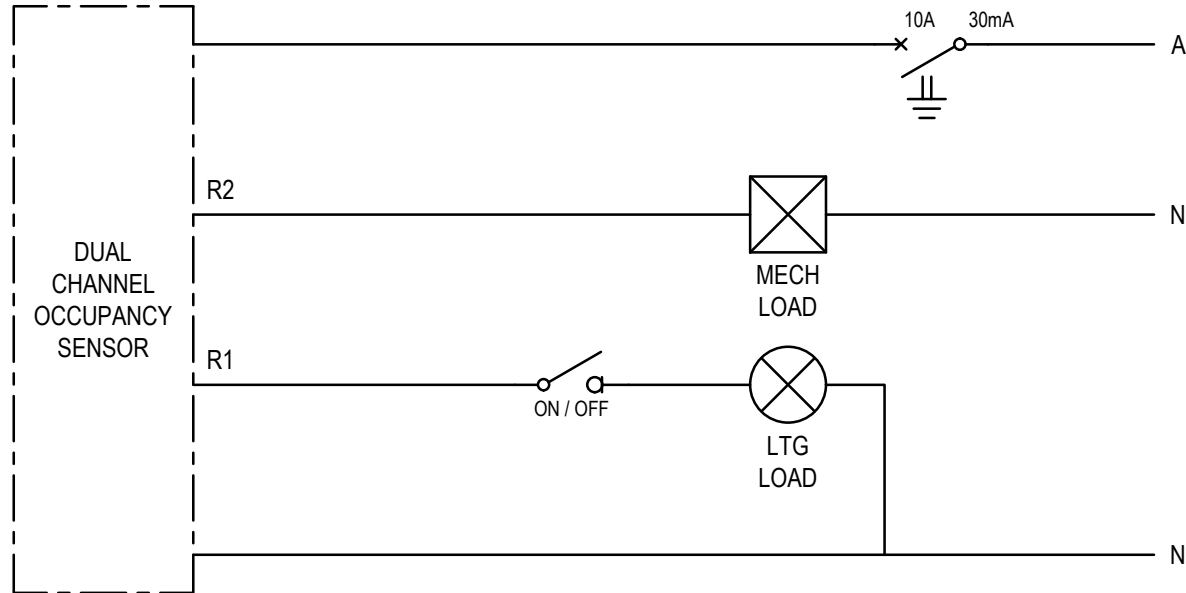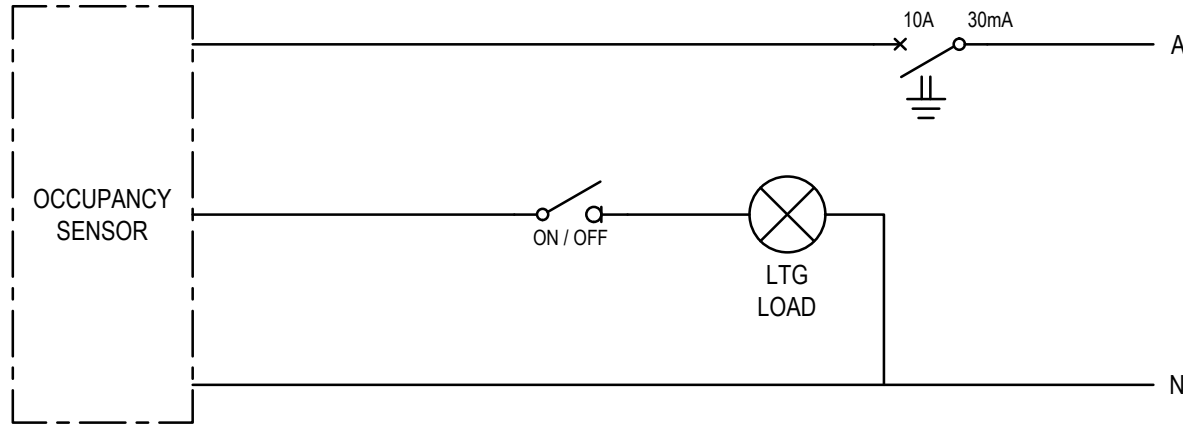

DRAWINGS TO BE READ IN CONJUNCTION WITH ELECTRICAL SPECIFICATION

3 WIRING OF SINGLE CHANNEL OCCUPANCY SENSOR AND MANUAL OVERRIDE ON/OFF ROOM LIGHT SWITCH

3 WIRING OF MULTI-CHANNEL OCCUPANCY SENSOR AND MANUAL OVERRIDE ON/OFF ROOM LIGHT SWITCH

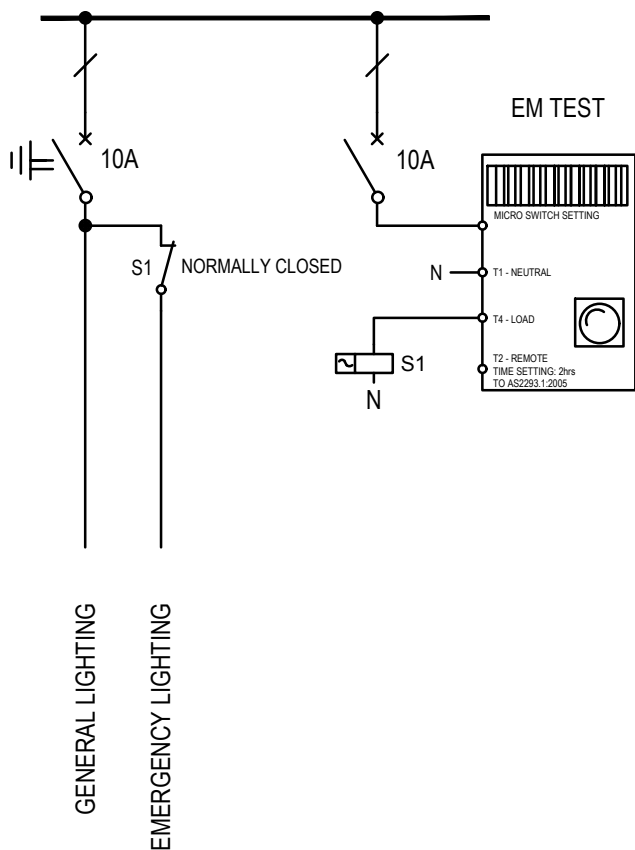

5 WIRING OF EMERGENCY LIGHTING FED FROM LOCAL LIGHTING CIRCUIT c/w TEST FACILITY

1	22-06-18	BUILDING RULES CONSENT	CLB	
0	18-05-18	BUILDING RULES CONSENT	CLB	
Rev	Date	Issue Description	By	
Project PROPOSED COMMERCIAL DEVELOPMENT 97 KING WILLIAM STREET KENT TOWN				
Title ELECTRICAL SERVICES LIGHTING DETAILS				
Architect ANTHONY DONATO ARCHITECTS Suite 5/59 Fullarton Road Kent Town SA 5087 t: 08 8364 6888 f: 08 8364 5355 www.adarchitects.com.au				
SECON consulting engineers 466 PULTENEY STREET ADELAIDE SOUTH AUSTRALIA 5000 TEL: 08 8223 7800 engineers@secon.net.au A.B.N. 30 613 300 299 A.C.N. 613 300 299				
© COPYRIGHT SECON PTY. LTD. 2017				
North	DRAWN	CLB	CHECKED	
	ENG	RB	Q.A.	AD
	DATE	MAR 18	SCALE	NTS
			SHEET	7 OF X
DRAWING No. 22/06/2018		B8014-E07		
PLOT DATE:		Size A1	Rev. 1	