


# SOUTH AUSTRALIAN WATER CORPORATION : FLOW AND PRESSURE SURVEY

## 201708132 METERING STRATEGY UNIT, TORRENSVILLE

# TEST 1

LOCATION	COMMERCIAL RD	This advice and/or information is given for your private use only. The accuracy of the advice and/or information is not guaranteed and no responsibility is accepted by the Crown, the South Australian Water Corporation of their officers, agents of servants for any loss or damage caused by reliance upon this advice and/ or information, as a result of any error, omission, misrepresenting therein whether caused by negligence or otherwise.			
SUBURB	PORT ADELAIDE				
MAIN-SIZE& TYPE	250mm CI				
ZONE SUPPLY EL					
TEST DATE	13/08/2017	TEMP	14C	TIME OF DAY	8:30 AM
					FIRE PLUG ID
					3421630

## SA WATER FLOW AND PRESSURE SURVEY

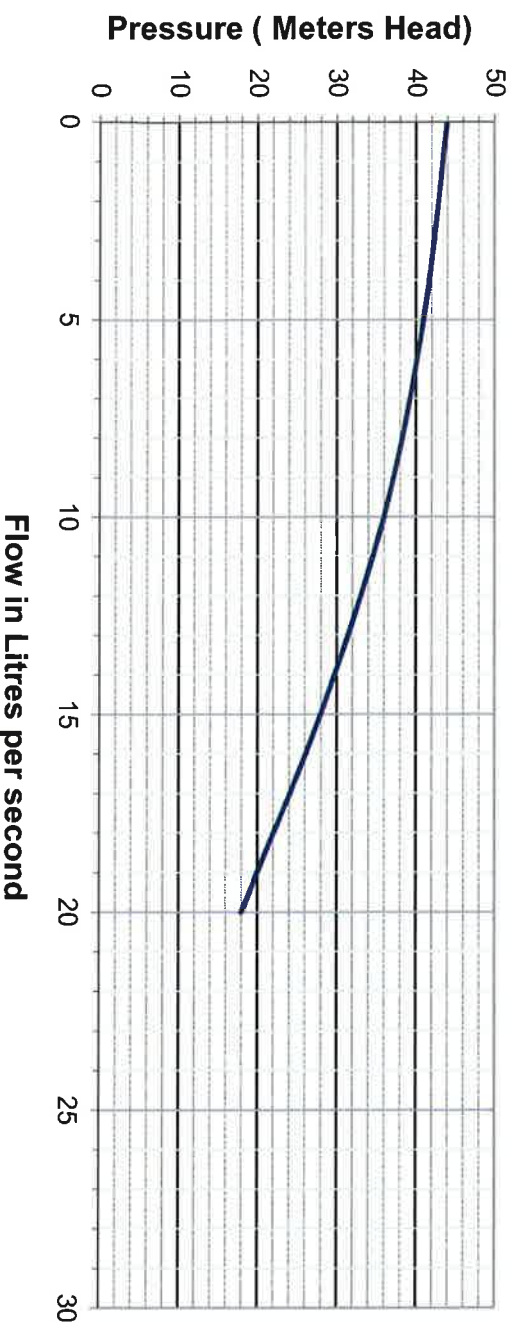

THE TEST WAS TAKEN USING A SINGLE 65mm McCROMETER METER, WITH THE PRESSURE AND FLOW TAKEN AT THE SAME POINT, USING A SINGLE FIRE PLUG OR PILLAR HYDRANT AS INDICATED.

STATIC PRESSURE 44.0 MH

RESULTS TAKEN FROM A McCROMETER METER

Flow rate in litres per second	Pressure in metres head
0	44
5.0	41
10.0	36
15.0	28
19.0	20
20.0	18

### PLEASE NOTE:

WHEN INCORPORATING THESE TEST RESULTS IN THE DESIGN CALCULATIONS OF THE PRIVATE SERVICE PIPEWORK, ALLOWANCE SHOULD BE MADE FOR HYDRAULIC LOSSES BETWEEN THE POINTS AT WHICH THE TEST WAS CONDUCTED AND THE PROPERTY SERVICE LOCATION.

THE CORPORATION ENDEAVOURS TO MAINTAIN A SATISFACTORY PRESSURE IN THE MAINS AT ALL TIMES, UNDER SOME CIRCUMSTANCES THIS MAY NOT BE POSSIBLE, THEREFORE NO GUARANTEE CAN BE GIVEN.

AT A PRESSURE OF 200 kpa, THE FLOW WAS :  
19.0 LITRES PER SECOND

CONTACT NAME : P.HUTCHINSON 7424 3253  
TEST BY: P.DIMASCIO, ALLWATER

# SOUTH AUSTRALIAN WATER CORPORATION : FLOW AND PRESSURE SURVEY

## 201708103 METERING STRATEGY UNIT, TORRENSVILLE


# TEST 2

LOCATION	COMMERCIAL RD	This advice and/or information is given for your private use only. The accuracy of the advice and/or information is not guaranteed and no responsibility is accepted by the Crown, the South Australian Water Corporation of their officers, agents of servants for any loss or damage caused by reliance upon this advice and/ or information, as a result of any error, omission, misrepresenting therein whether caused by negligence or otherwise.			
SUBURB	PORT ADELAIDE				
MAIN-SIZE& TYPE	150mm AC				
ZONE SUPPLY EL					
TEST DATE	10/08/2017	TEMP	14C	TIME OF DAY	12:20 PM
FIRE PLUG ID					3421583



SA WATER

## FLOW AND PRESSURE SURVEY

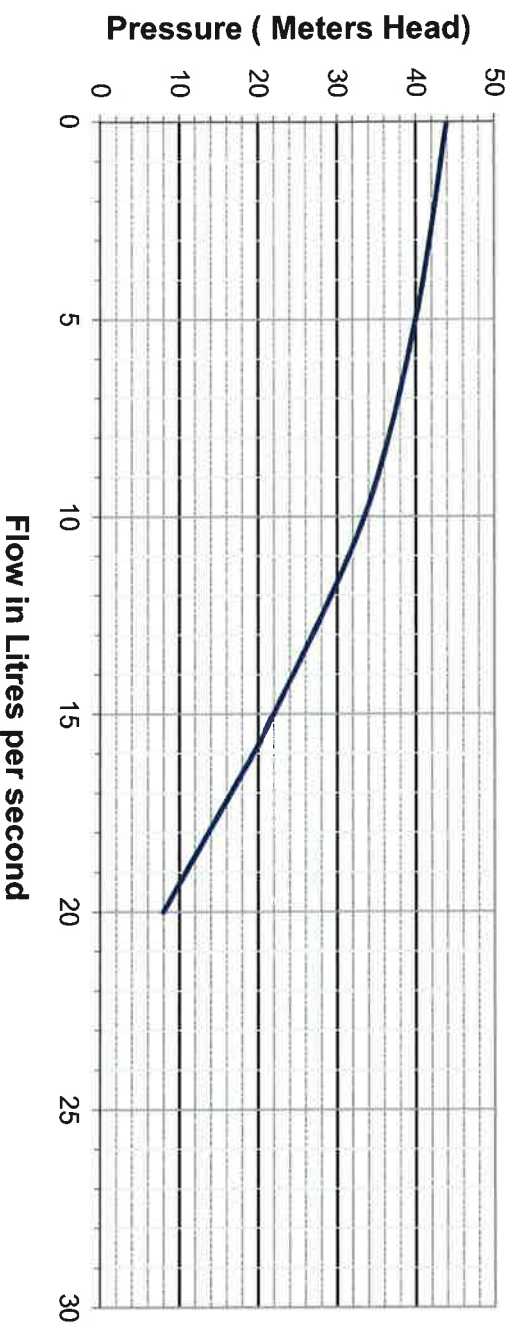

### PLEASE NOTE:

WHEN INCORPORATING THESE TEST RESULTS IN THE DESIGN CALCULATIONS OF THE PRIVATE SERVICE PIPEWORK, ALLOWANCE SHOULD BE MADE FOR HYDRAULIC LOSSES BETWEEN THE POINTS AT WHICH THE TEST WAS CONDUCTED AND THE PROPERTY SERVICE LOCATION.  
*THE CORPORATION ENDEAVOURS TO MAINTAIN A SATISFACTORY PRESSURE IN THE MAINS AT ALL TIMES, UNDER SOME CIRCUMSTANCES THIS MAY NOT BE POSSIBLE, THEREFORE NO GUARANTEE CAN BE GIVEN.*

**AT A PRESSURE OF 200 kpa, THE FLOW WAS :  
15.8 LITRES PER SECOND**

CONTACT NAME : P.HUTCHINSON 7424 3253  
 TEST BY: P.DIMASCIO, ALLWATER

Getting Around Map & Data Sources Tasks Analysis General Search Network Registration

Scale 1:500

Results (4)

ID: 833837  
SPN: 1220  
Connect: type Direct

Address: 76 COMMERCIAL RD  
PORT ADELAIDE  
Postcode: 5015

SPN: 1220

Name: PORT ADELAIDE  
Postcode: 5015

