


Ground Floor

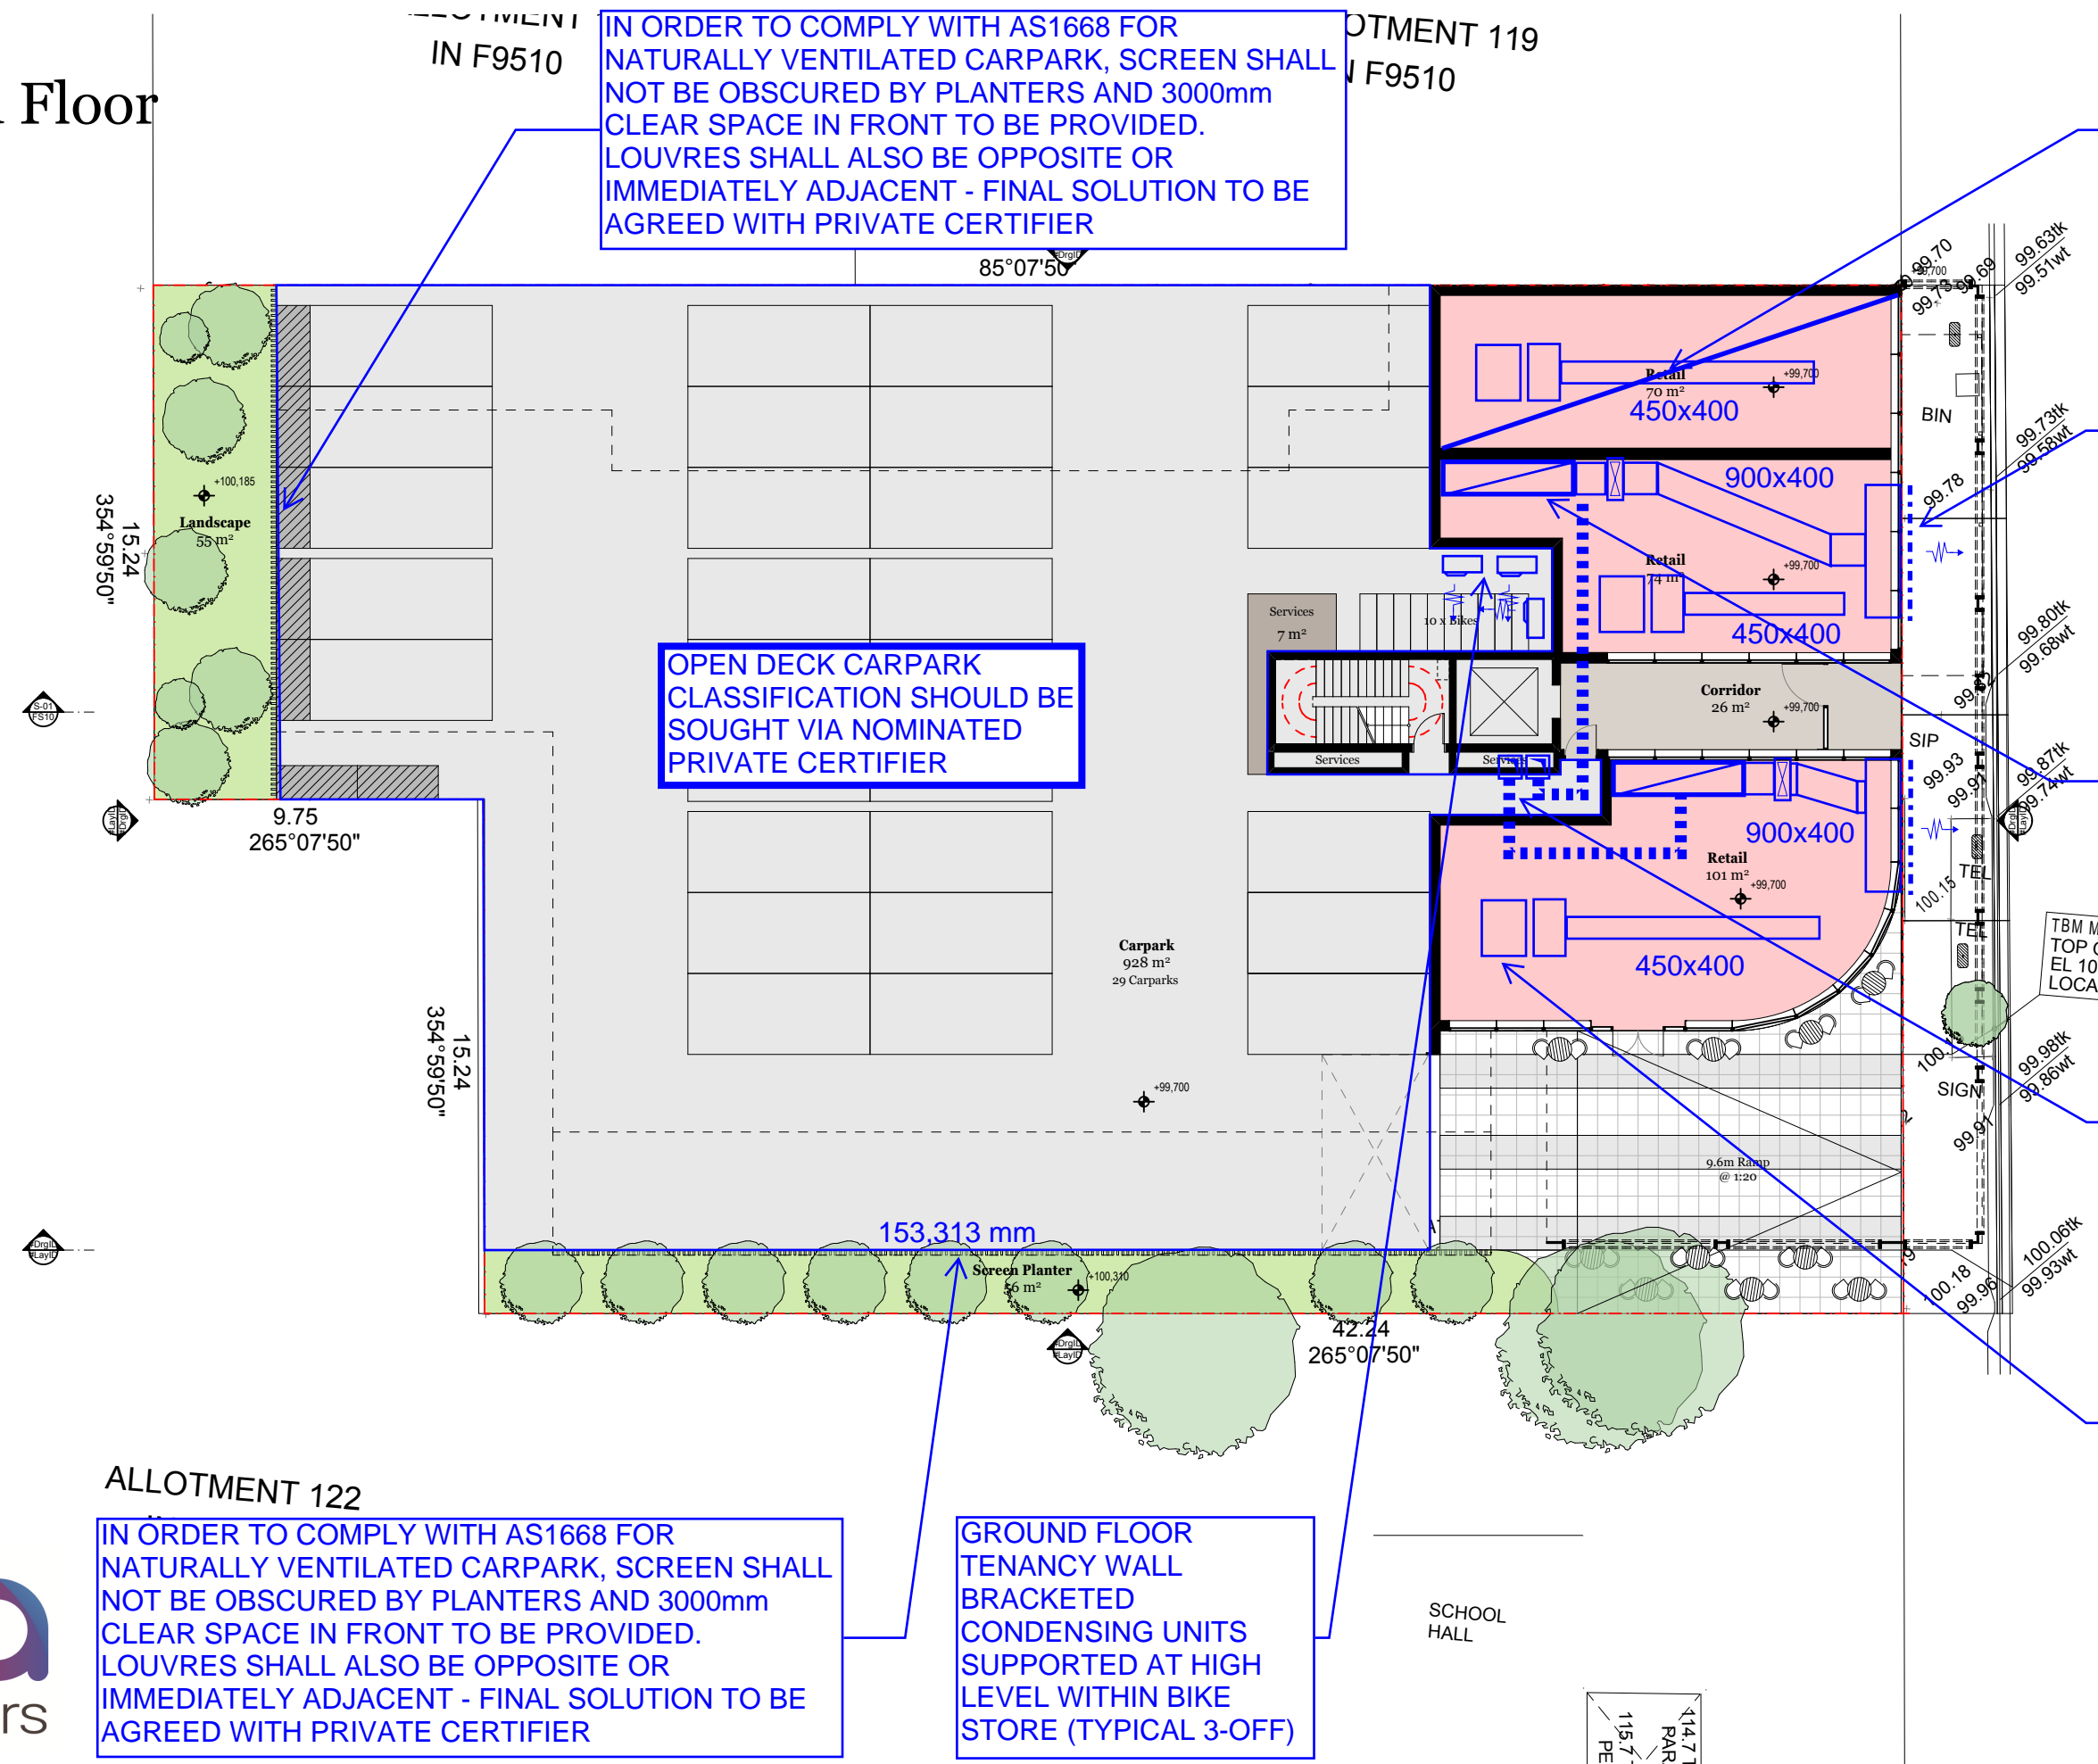

IN ORDER TO COMPLY WITH AS1668 FOR NATURALLY VENTILATED CARPARK, SCREEN SHALL NOT BE OBSCURED BY PLANTERS AND 3000mm CLEAR SPACE IN FRONT TO BE PROVIDED. LOUVRES SHALL ALSO BE OPPOSITE OR IMMEDIATELY ADJACENT - FINAL SOLUTION TO BE AGREED WITH PRIVATE CERTIFIER

OPEN DECK CARPARK CLASSIFICATION SHOULD BE SOUGHT VIA NOMINATED PRIVATE CERTIFIER

DESIGNATED NON-FOOD TENANCY?

2m² (4000mm x 500mm WEATHERPROOF LOUVRE AT 50% FREE AREA) EXHAUST AIR DISCHARGE LOUVRE TO FACADE @ 3000mm AFL IF ENGINEERED HOOD SOLUTION WITH OZONE GENERATION AND ELECTROSTATIC FILTERS USED (TYPICAL 3-OFF)

INDICATIVE 4000mm LONG KITCHEN EXTRACTION HOOD. FINAL LAYOUT, LENGTH AND PROPOSED EQUIPMENT UNDER TO BE CONFIRMED. 4000mm HOOD NOMINALLY AT 2500L/s FOR ENGINEERED HOOD

NO ENGINEERED HOOD SOLUTION WITH NO OZONE GENERATION AND ELECTROSTATIC FILTERS USED.
REQUIRES:
1-OFF 600x600 EXHAUST DUCTWORK RISER PER HOOD VIA FLOORS ABOVE TO ROOF LEVEL DISCHARGE FAN

DUCTED AIR CONDITONING UNIT PER TENANCY - MINIMUM 800mm CEILING SPACE REQUIRED (TYPICAL 3-OFF)

NOTE: SHOULD TEMPERED KITCHEN EXHAUST MAKE UP AIR BE REQUIRED, EVAPORATIVE COOLERS TO BE MOUNTED AT ROOF LEVEL AND 600x600 DUCTWORK DROPPING FROM ROOF LEVEL TO GROUND FLOOR CEILING SPACE (2-OFF)

GROUND FLOOR TENANCY WALL BRACKETED CONDENSING UNITS SUPPORTED AT HIGH LEVEL WITHIN BIKE STORE (TYPICAL 3-OFF)


IN ORDER TO COMPLY WITH AS1668 FOR NATURALLY VENTILATED CARPARK, SCREEN SHALL NOT BE OBSCURED BY PLANTERS AND 3000mm CLEAR SPACE IN FRONT TO BE PROVIDED. LOUVRES SHALL ALSO BE OPPOSITE OR IMMEDIATELY ADJACENT - FINAL SOLUTION TO BE AGREED WITH PRIVATE CERTIFIER



134-136 Goodwood Road
Goodwood SA 5034

Ground Floor
18/05/18
Page: 7

© DKO Architecture (VIC) Pty Ltd
Except as allowed under copyright act, no part of this drawing may be reproduced or otherwise dealt with without written permission of DKO Architecture.



Scale: 1:200 @ A3


Level 1 Plan



134-136 Goodwood Road
Goodwood SA 5034

Level 1 Plan
18/05/18
Page: 8



© DKO Architecture (VIC) Pty Ltd
Except as allowed under copyright act, no part of this
drawing may be reproduced or otherwise dealt with
without written permission of DKO Architecture.



Scale: 1:200 @ A3
0 1 2 3 4 5

NOTE: SHOULD TEMPERED
KITCHEN EXHAUST MAKE
UP AIR BE REQUIRED,
EVAPORATIVE COOLERS
TO BE MOUNTED AT ROOF
LEVEL AND 600x600
DUCTWORK DROPPING
FROM ROOF LEVEL TO
GROUND FLOOR CEILING
SPACE (2-OFF)

Level 2 Plan

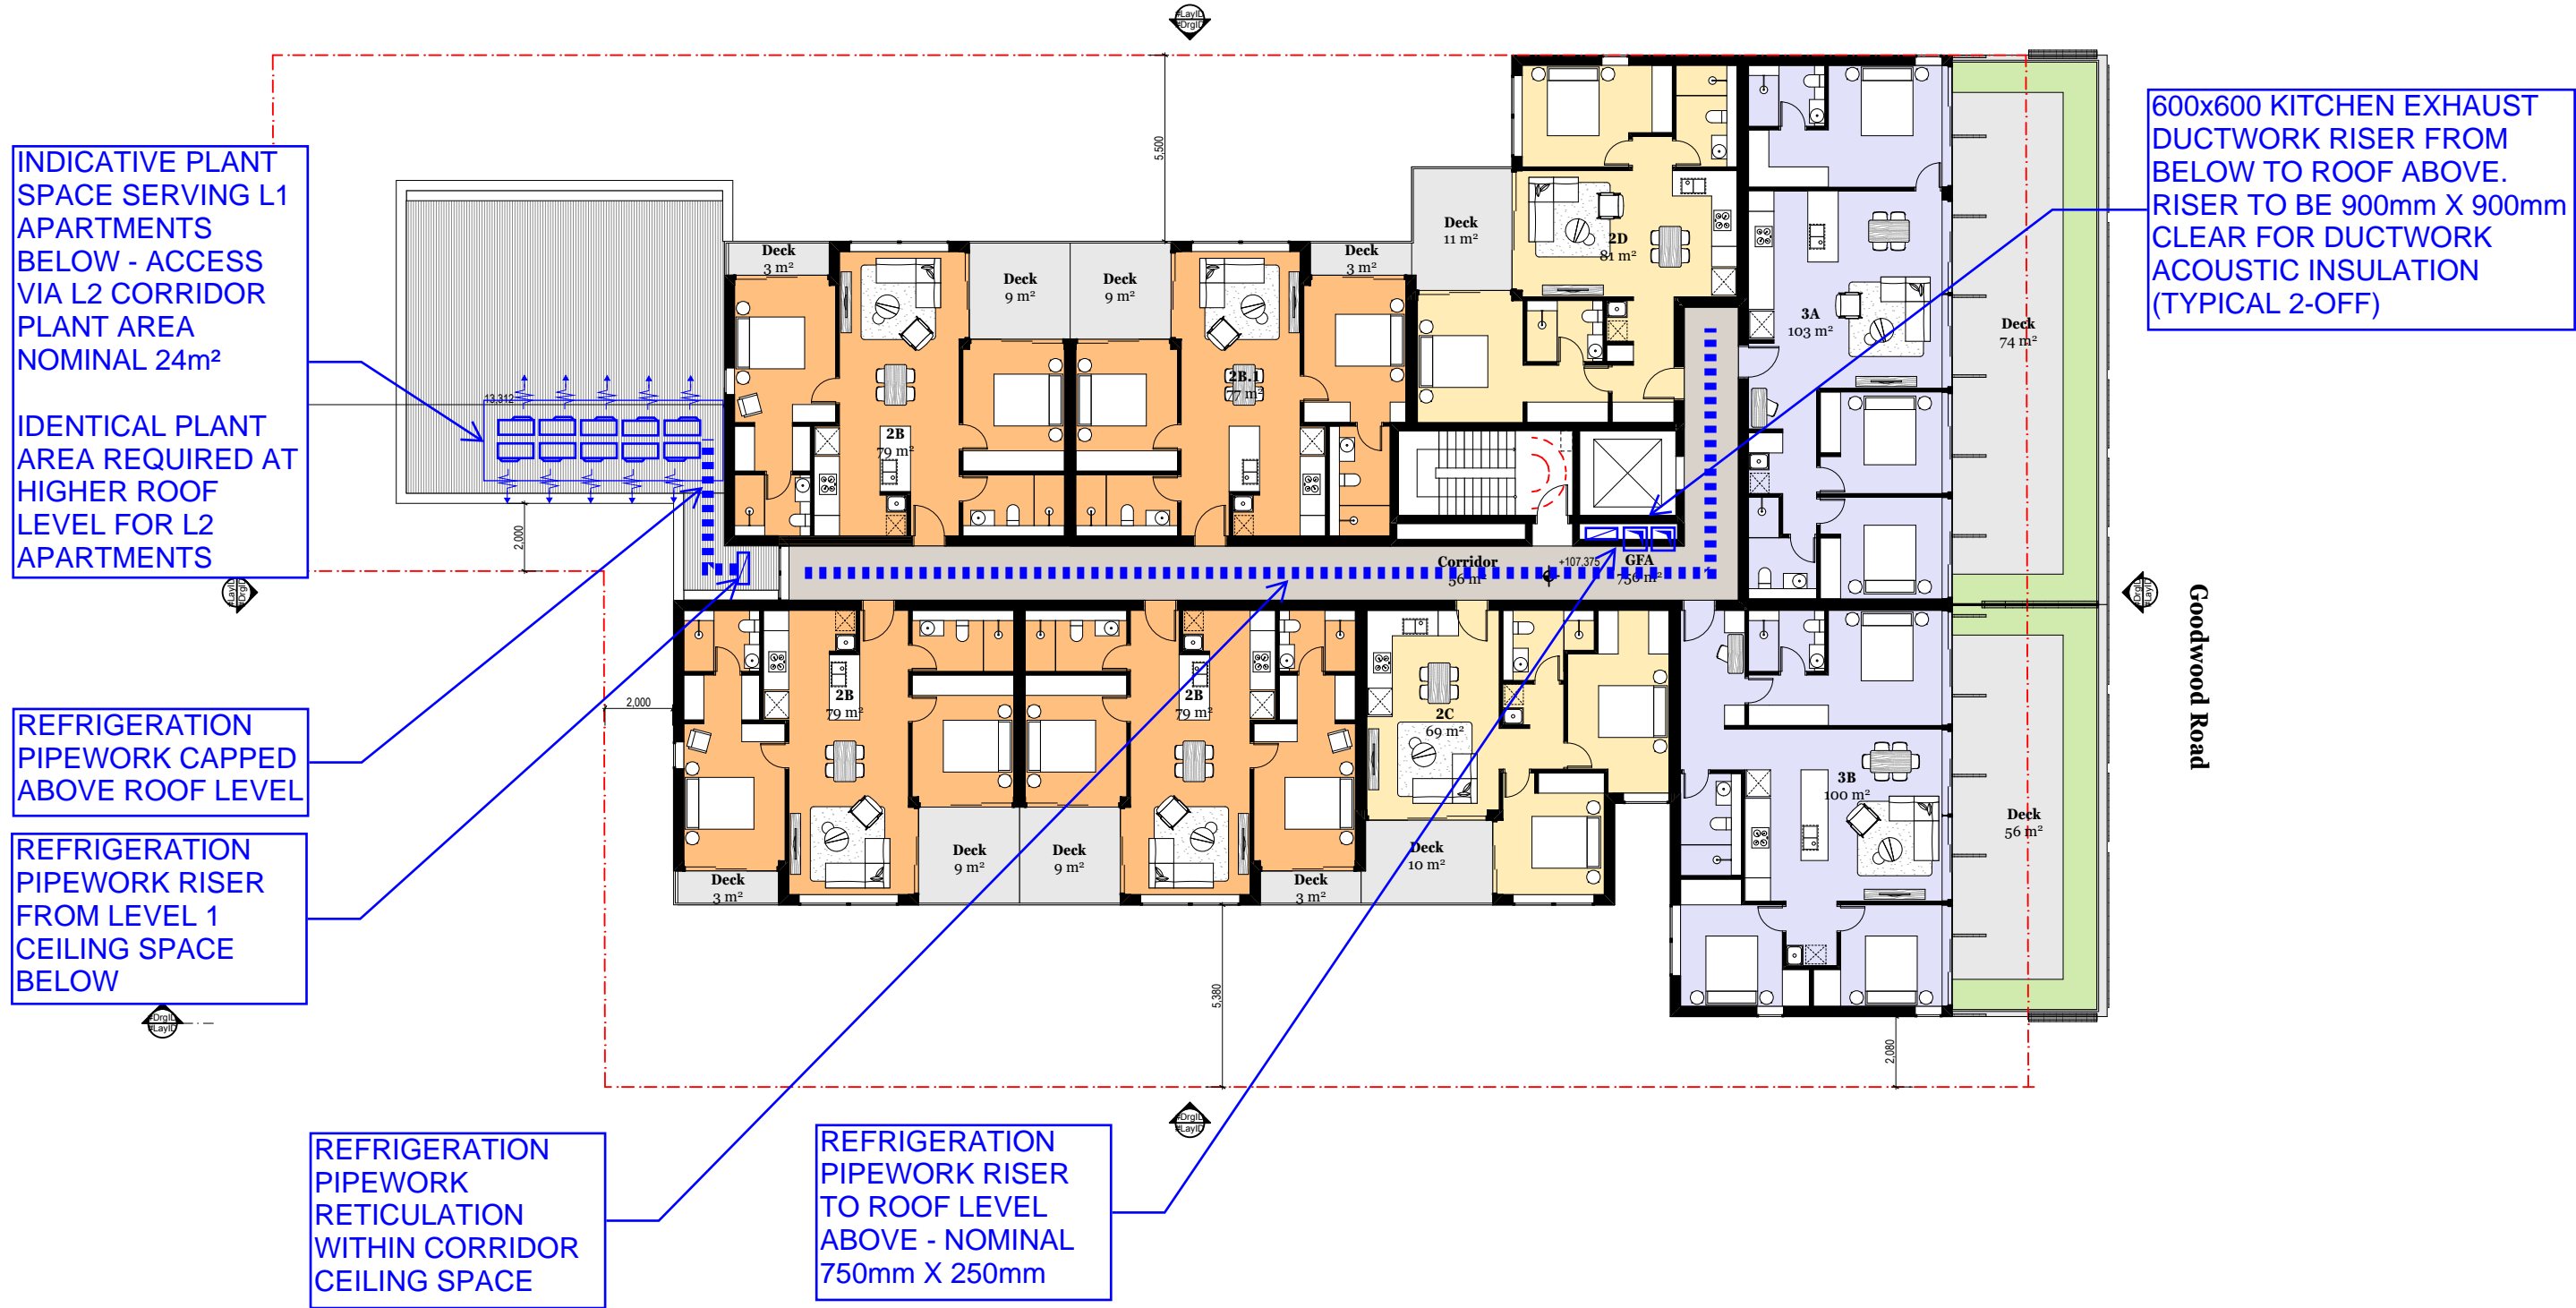

NOTE: SHOULD TEMPERED KITCHEN EXHAUST MAKE UP AIR BE REQUIRED, EVAPORATIVE COOLERS TO BE MOUNTED AT ROOF LEVEL AND 600x600 DUCTWORK DROPPING FROM ROOF LEVEL TO GROUND FLOOR CEILING SPACE (2-OFF)