

CAR PARK SUPPLY AIR DUCTWORK EXPOSED AND RETICULATING ALONG WESTERN WALL AT HIGH LEVEL TO MAINTAIN 2100mm CLEARANCE. AIR SUPPLIED TO CAR PARK VIA EGGRATE GRILLES IN SIDE OF DUCT.

CAR PARK EXHAUST DUCTWORK TO RISE IN LOCATION ALIGNING WITH FIRE RATED RISER IN GROUND FLOOR TENANCY ABOVE.


CAR PARK EXHAUST DUCTWORK TO MAINTAIN 2100mm CLEARANCE IN BASEMENT CAR PARK, TYPICAL.

CARBON MONOXIDE MONITORING STATION.

CARBON MONOXIDE SENSOR TO BE CONNECTED WITH CAR PARK EXHAUST AND MAKE UP AIR SYSTEMS, TYPICAL.


EGGRATE TYPE GRILLES TO BE MOUNTED IN SIDE OF DUCT FOR CAR PARK EXHAUST AND SUPPLY AIR, TYPICAL.

TUNDISH IN BASEMENT TO PROVIDE GROUND FLOOR CONDENSING UNITS WITH CONDENSATE DRAINAGE. TUNDISH TO BE PROVIDED BY HYDRAULIC SERVICES, TYPICAL.

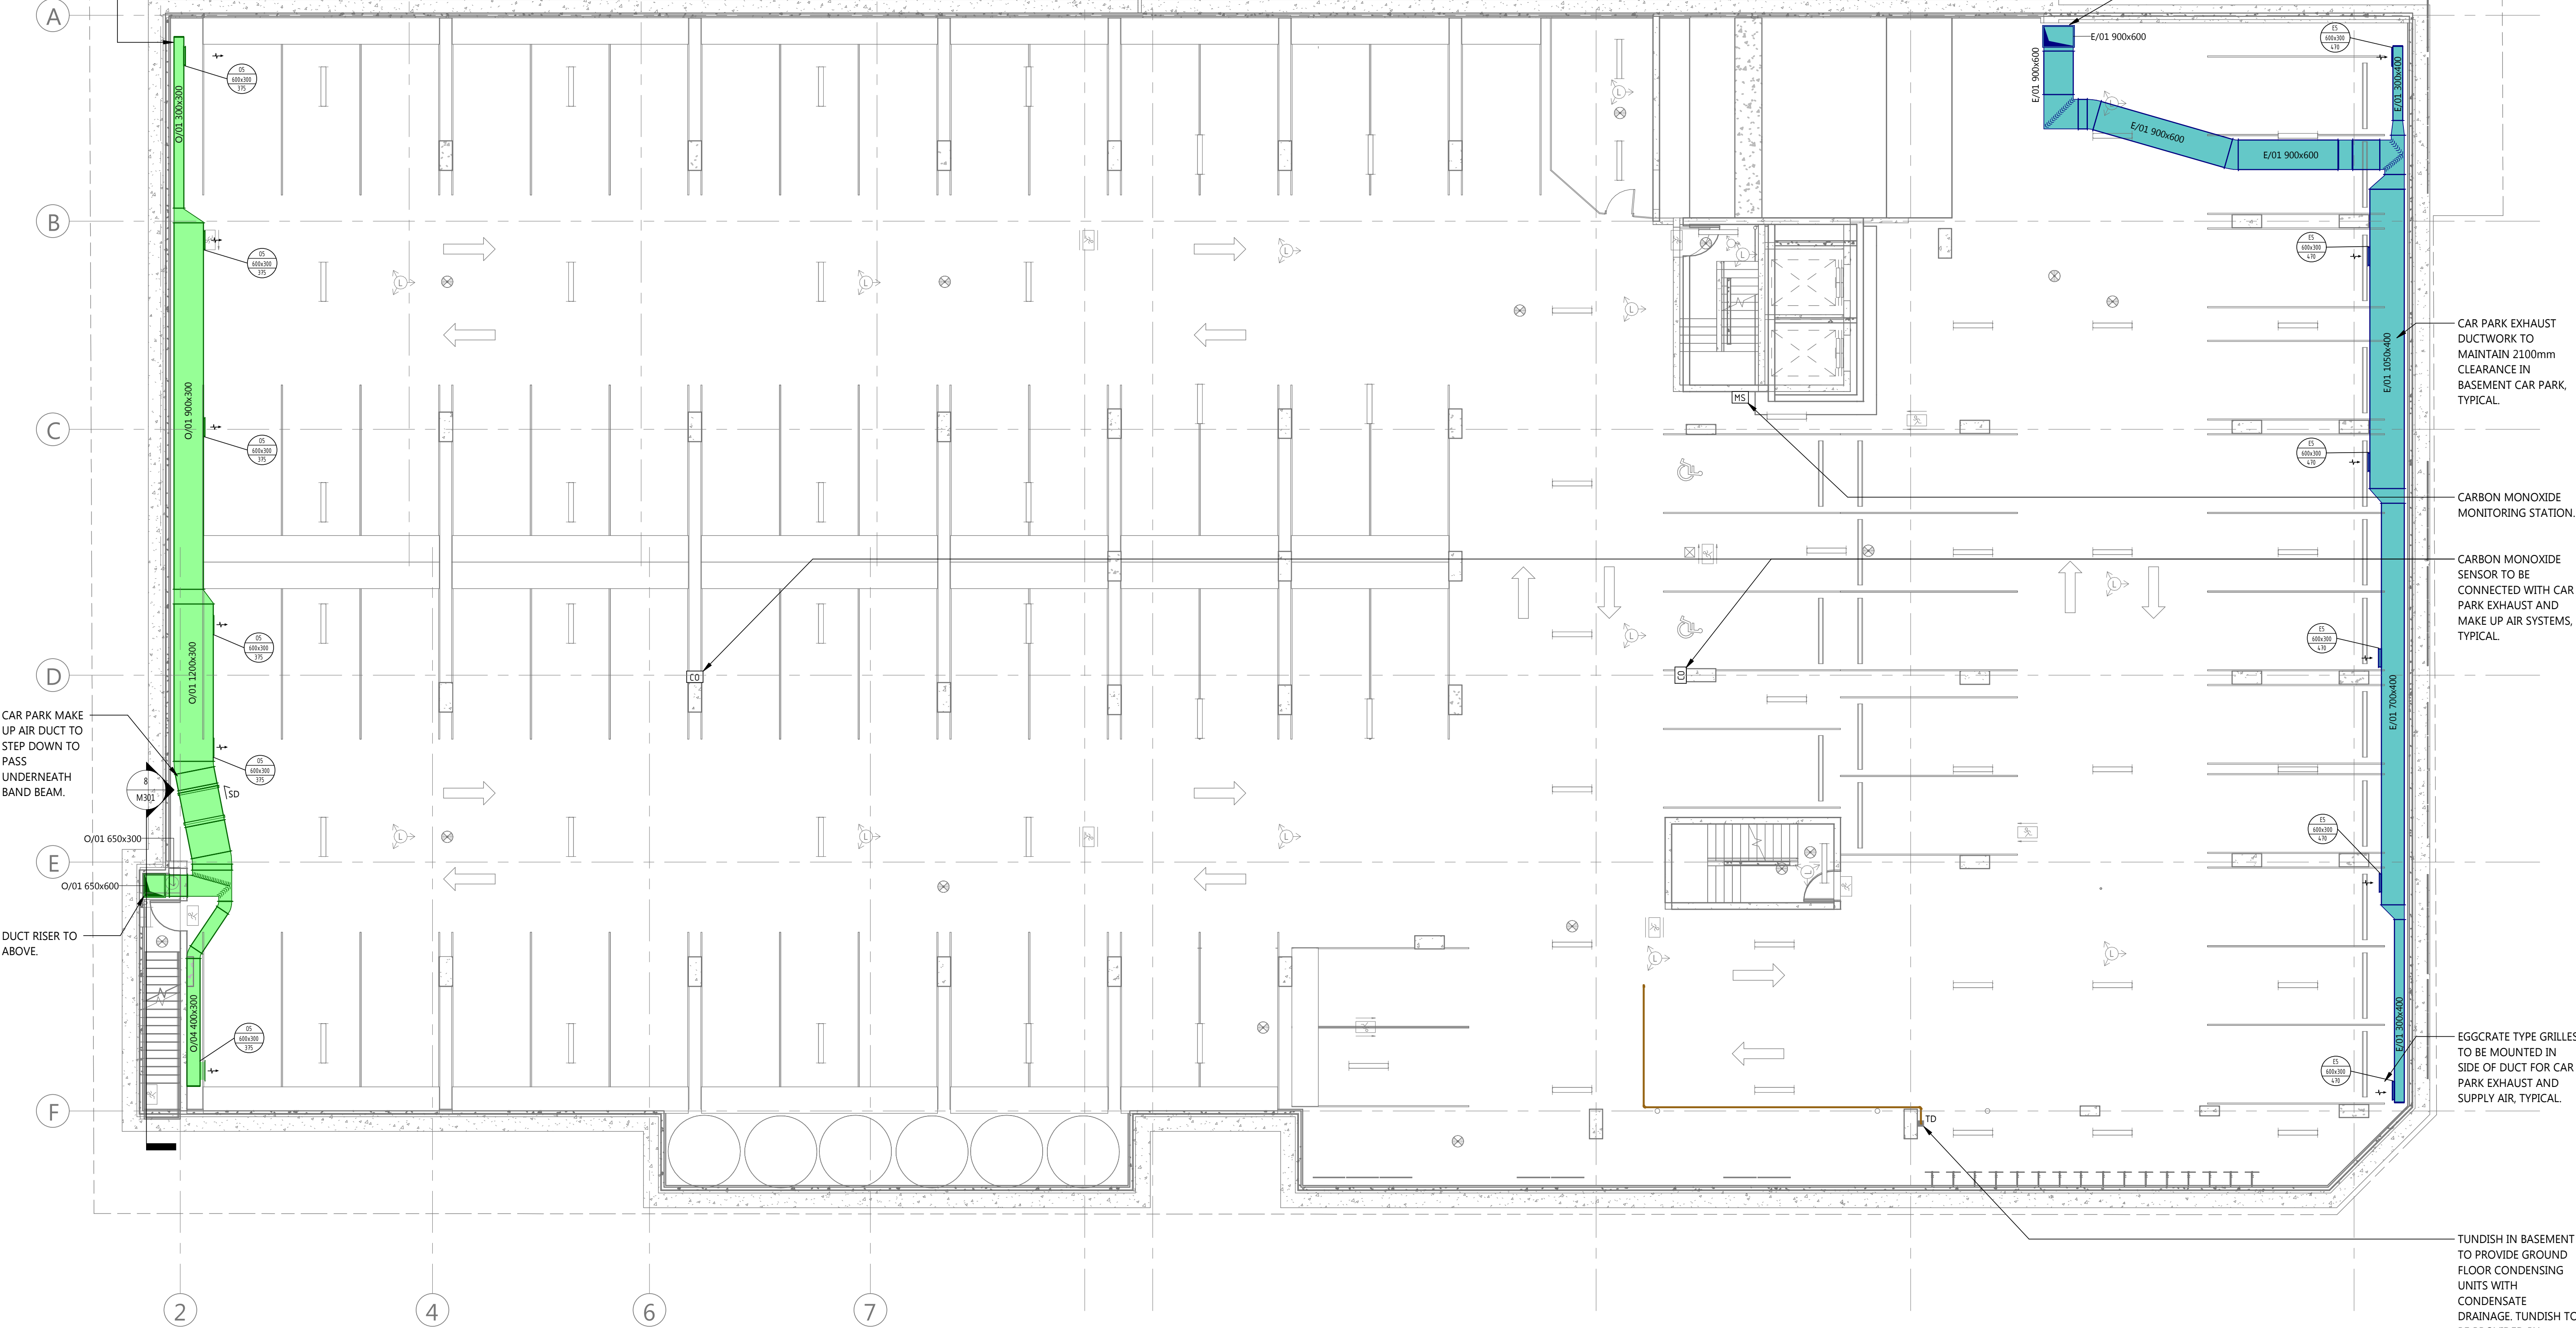


REV	DESCRIPTION	DATE	CHKD
B	CONSTRUCTION ISSUE	24.03.20	TR
A	CONSTRUCTION ISSUE	14.01.20	TR

FOR CONSTRUCTION




TO BE PRINTED IN COLOUR

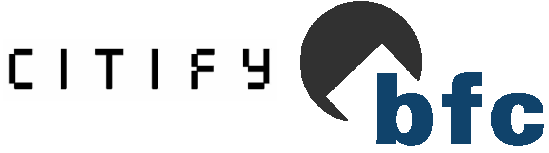

LUCID
CONSULTING AUSTRALIA
Level 3/169, Pirie St Adelaide SA 5000
Phone: (08) 8407 9700
Email: adelaide@lucidconsulting.com.au

PROJECT
HYDE PARK PLACE
248 UNLEY ROAD, HYDE PARK
MECHANICAL SERVICES
DRAWING
BASEMENT MECHANICAL SERVICES ARRANGEMENT



NOT FOR CONSTRUCTION PURPOSES UNLESS STAMPED FOR CONSTRUCTION. VERIFY DIMENSIONS AND LEVELS ON SITE BEFORE SETTING OUT. DO NOT SCALE. REFER TO FIGURED DIMENSIONS - IN mm UNLESS OTHERWISE STATED.			
Scale	Design: JD/TC	No. in Set	Date
1 : 100	Drawn: JD	4 of 15	JAN 2020
Orig. Size	Drawing no.	Revision	
A1	LCE14462-M200	B	