


1. DOOR ACCESS CONTROL WITHIN STAIRWELL TO BE CONFIGURED AS 'FALL-SAFE', WITH ELECTRIC STRIKE TO RELEASE ON FIRE ALARM SIGNAL.
2. BALCONY OUTLETS AND EXHAUST FANS WITHIN APARTMENTS TO BE SUPPLIED FROM LOCAL APARTMENT LOAD CENTRE. FAN TO BE SWITCHED FROM 2ND POLE OF LOCAL LIGHT SWITCH. TYPICAL.
3. REFER TO ARCHITECTURAL DOCUMENTATION FOR FULL REQUIREMENTS OF ELECTRICAL INSTALLATION WITHIN APARTMENTS. PROVIDE ALL REQUIRED MATERIALS AND FIXTURES AND INSTALL ACCORDING TO ARCHITECT SET-OUT (TYPICAL).

FINAL SAUNA POWER REQUIREMENTS AND ISOLATOR LOCATION TO BE COORDINATED BY ELECTRICAL CONTRACTOR.

CONTAINS:

- BUILDING OPTICOMM DISTRIBUTION
- ELECTRICAL METER PANELS
- SECURITY/MATV/INTERCOM EQUIPMENT

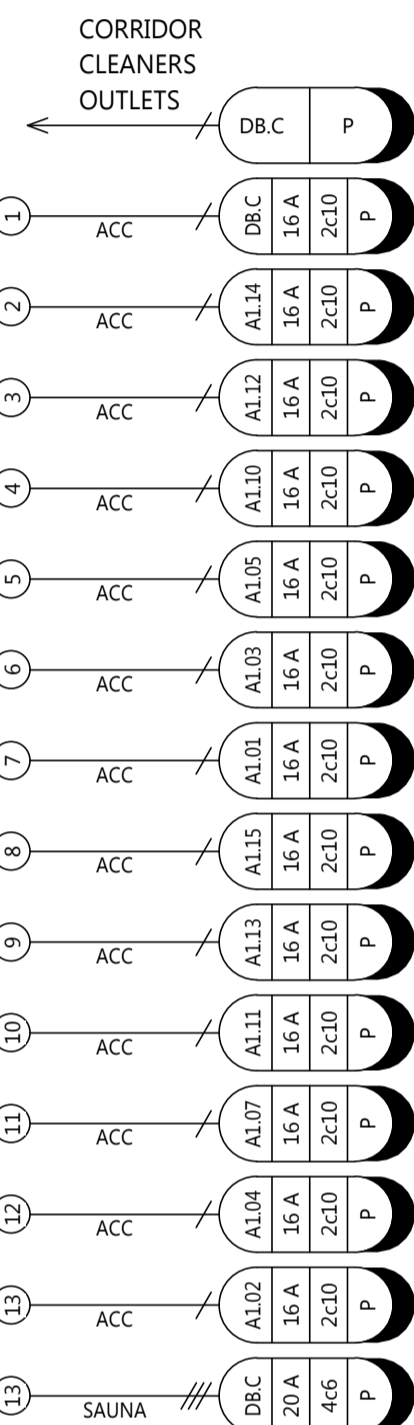

TENDER ISSUE


CITIFY  bfc

GEMMA | LEA
www.gemma.com.au
gemma@gemma.com.au
 ABN: 29 952 997 830

DESIGN STUDIO

PROJECT
HYDE PARK PLACE
248 UNLEY ROAD, HYDE PARK
ELECTRICAL SERVICES

DRAWING
2ND FLOOR POWER, COMMUNICATIONS AND
SECURITY ARRANGEMENT



NOT FOR CONSTRUCTION PURPOSES UNLESS STAMPED FOR
CONSTRUCTION. VERIFY DIMENSIONS AND LEVELS ON SITE
BEFORE SETTING OUT. DO NOT SCALE. REFER TO FIGURED
DIMENSIONS - IN mm UNLESS OTHERWISE STATED.

Scale	Design: MD	No. in Set	Date
1 : 100	Drawn: PY Review: PAC	8 of 24	MAY 2019

Orig. Size	Drawing no.	Revision
A1	LCE14462-E203	T1