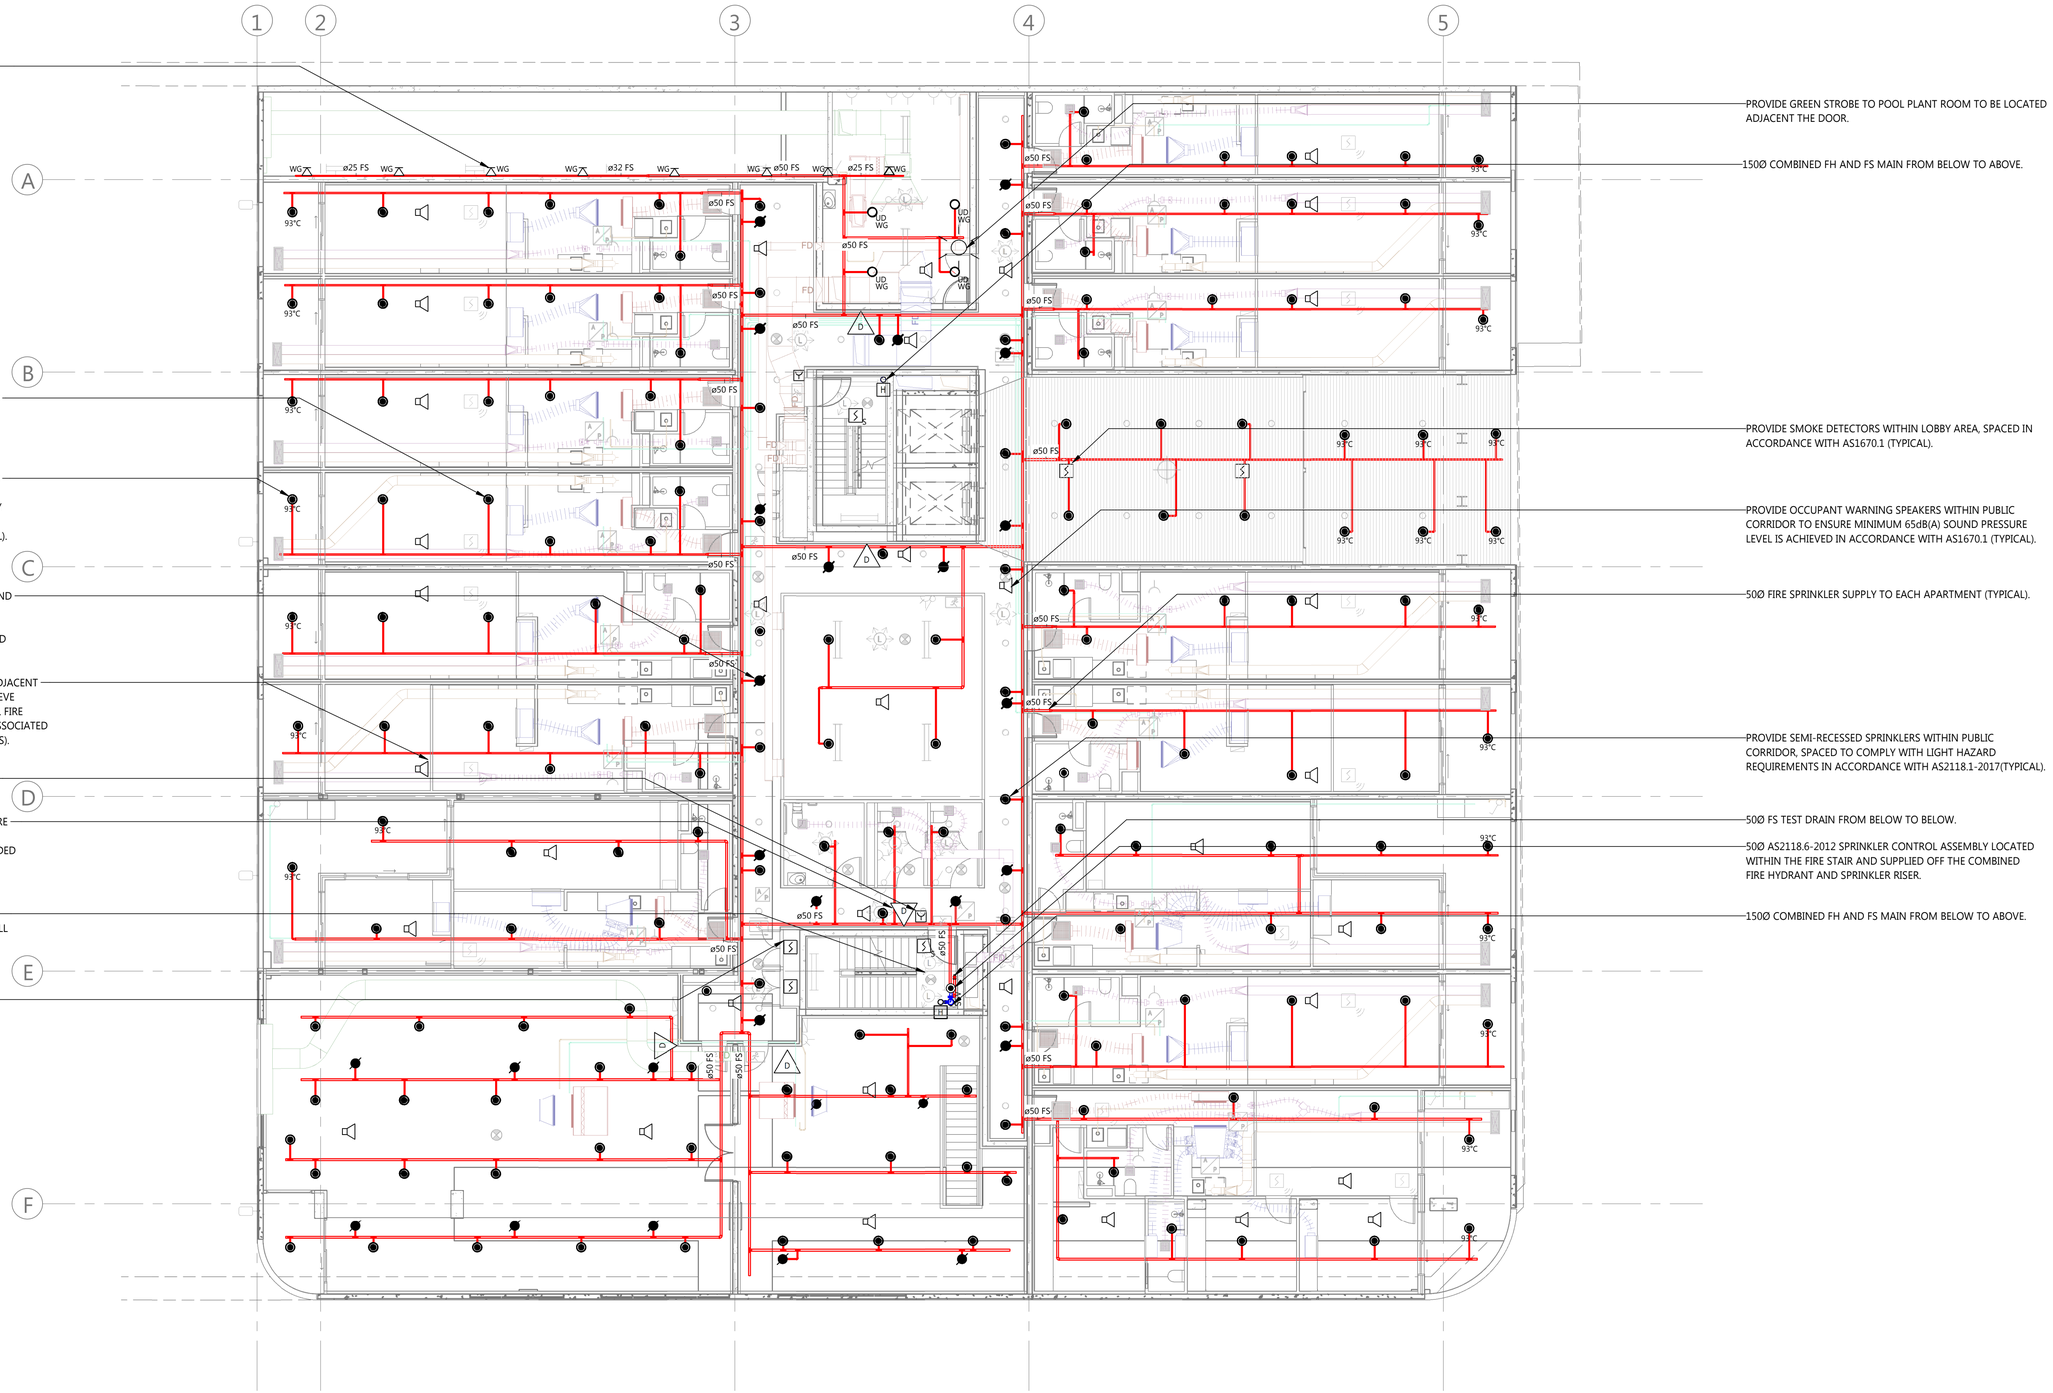

PROVIDE SIDE WALL SPRINKLERS WITHIN POOL PLANT ROOM COMPLETE WITH WIRE GUARD, SPACED TO COMPLY WITH LIGHT HAZARD REQUIREMENTS IN ACCORDANCE WITH AS2118.1-2017(TYPICAL).

PROVIDE RESIDENTIAL TYPE SEMI-RECESSED SPRINKLERS WITHIN APARTMENT, SPACED TO COMPLY WITH LIGHT HAZARD REQUIREMENTS IN ACCORDANCE WITH AS2118.1-2017(TYPICAL).

PROVIDE RESIDENTIAL TYPE SEMI-RECESSED SPRINKLERS RATED TO 93°C WITHIN APARTMENT BALCONY, SPACED TO COMPLY WITH LIGHT HAZARD REQUIREMENTS IN ACCORDANCE WITH AS2118.1-2017(TYPICAL).

PROVIDE CONCEALED SPACE SPRINKLERS AND SPACED TO COMPLY WITH LIGHT HAZARD REQUIREMENTS IN ACCORDANCE WITH AS2118.1-2017 (TYPICAL WITHIN CONCEALED SPACE IN PUBLIC CORRIDOR).

PROVIDE OCCUPANT WARNING SPEAKER ADJACENT TO BEDHEAD WITHIN APARTMENT TO ACHIEVE MINIMUM 75dB(A) SOUND PRESSURE LEVEL. FIRE SERVICES CONTRACTOR TO PROVIDE ALL ASSOCIATED CABLING (TYPICAL WITHIN ALL APARTMENTS).

PROVIDE MANUAL CALL POINT ADJACENT TO EXIT INTO FIRE-ISOLATED STAIRWELL.

PROVIDE DRY CHEMICAL TYPE PORTABLE FIRE EXTINGUISHER WITHIN PUBLIC CORRIDOR. ENSURE ALL STATUTORY SIGNAGE IS PROVIDED IN ACCORDANCE WITH AS2444. REFER TO DRAWING LCE14462-F300 FOR DETAIL.

PROVIDE SURFACE-MOUNTED SMOKE DETECTOR WITHIN FIRE-ISOLATED STAIRWELL IN ACCORDANCE WITH AS1670.1 (TYPICAL).

PROVIDE SMOKE DETECTOR WITHIN ELECTRICAL SWITCHBOARD IN ACCORDANCE WITH AS1670.1. COORDINATE FINAL LOCATION AND INSTALLATION WITH ELECTRICAL SERVICES CONTRACTOR (TYPICAL).

PROVIDE GREEN STROBE TO POOL PLANT ROOM TO BE LOCATED ADJACENT THE DOOR.

150Ø COMBINED FH AND FS MAIN FROM BELOW TO ABOVE.

PROVIDE SMOKE DETECTORS WITHIN LOBBY AREA, SPACED IN ACCORDANCE WITH AS1670.1 (TYPICAL).

PROVIDE OCCUPANT WARNING SPEAKERS WITHIN PUBLIC CORRIDOR TO ENSURE MINIMUM 65dB(A) SOUND PRESSURE LEVEL IS ACHIEVED IN ACCORDANCE WITH AS1670.1 (TYPICAL).

50Ø FIRE SPRINKLER SUPPLY TO EACH APARTMENT (TYPICAL).

PROVIDE SEMI-RECESSED SPRINKLERS WITHIN PUBLIC CORRIDOR, SPACED TO COMPLY WITH LIGHT HAZARD REQUIREMENTS IN ACCORDANCE WITH AS2118.1-2017(TYPICAL).

50Ø FS TEST DRAIN FROM BELOW TO BELOW.

50Ø AS2118.6-2012 SPRINKLER CONTROL ASSEMBLY LOCATED WITHIN THE FIRE STAIR AND SUPPLIED OFF THE COMBINED FIRE HYDRANT AND SPRINKLER RISER.

150Ø COMBINED FH AND FS MAIN FROM BELOW TO ABOVE.

REV'N	DESCRIPTION	DATE	CHK'D
T1	TENDER ISSUE	23.05.19	MM

© Copyright Lucid Consulting Australia

5/23/2019 12:49:38 PM

TENDER ISSUE

1 0.5 0 0.5 1 2 3 4 5 m
SCALEBAR 1:100

TO BE PRINTED IN COLOUR

THE PURPOSE OF THIS DOCUMENT IS INTENDED TO BE VIEWED OR PRINTED IN COLOUR FOR THE FULL EXTENT OF THE SCOPE OF WORKS TO BE SHOWN.

CITIFY bfc GEMMA | LEA DESIGN STUDIO

LUCID CONSULTING AUSTRALIA
Level 3/169, Pirie St Adelaide SA 5000
Phone: (08) 8407 9700
Email: adelaide@lucidconsulting.au

PROJECT
HYDE PARK PLACE
248 UNLEY ROAD, HYDE PARK
FIRE SERVICES

DRAWING
1ST FLOOR FIRE SERVICES ARRANGEMENT

NOT FOR CONSTRUCTION PURPOSES UNLESS STAMPED FOR CONSTRUCTION. VERIFY DIMENSIONS AND LEVELS ON SITE BEFORE SETTING OUT. DO NOT SCALE. REFER TO FIGURED DIMENSIONS - IN mm UNLESS OTHERWISE STATED.

Scale	Design: LM/AR	No. in Set	Date
1 : 100	Drawn: SHA	6 of 14	MAY 2019
	Review: MM		
Orig. Size	Drawing no.		Revision
A1	LCE14462-F202		T1