



**NOTE:**  
PROVIDE PRESSURE REDUCING VALVES TO INCOMING COLD WATER AND HOT WATER SUPPLIES TO APARTMENTS AND BASE BUILDING AREAS AS REQUIRED TO ENSURE MAXIMUM SUPPLY PRESSURE DOES NOT EXCEED 500kPa. REFER TO SCHEMATIC ON DRAWING NUMBER 'LCE14462-H301' FOR FURTHER INFORMATION - NOT SHOWN FOR CLARITY.

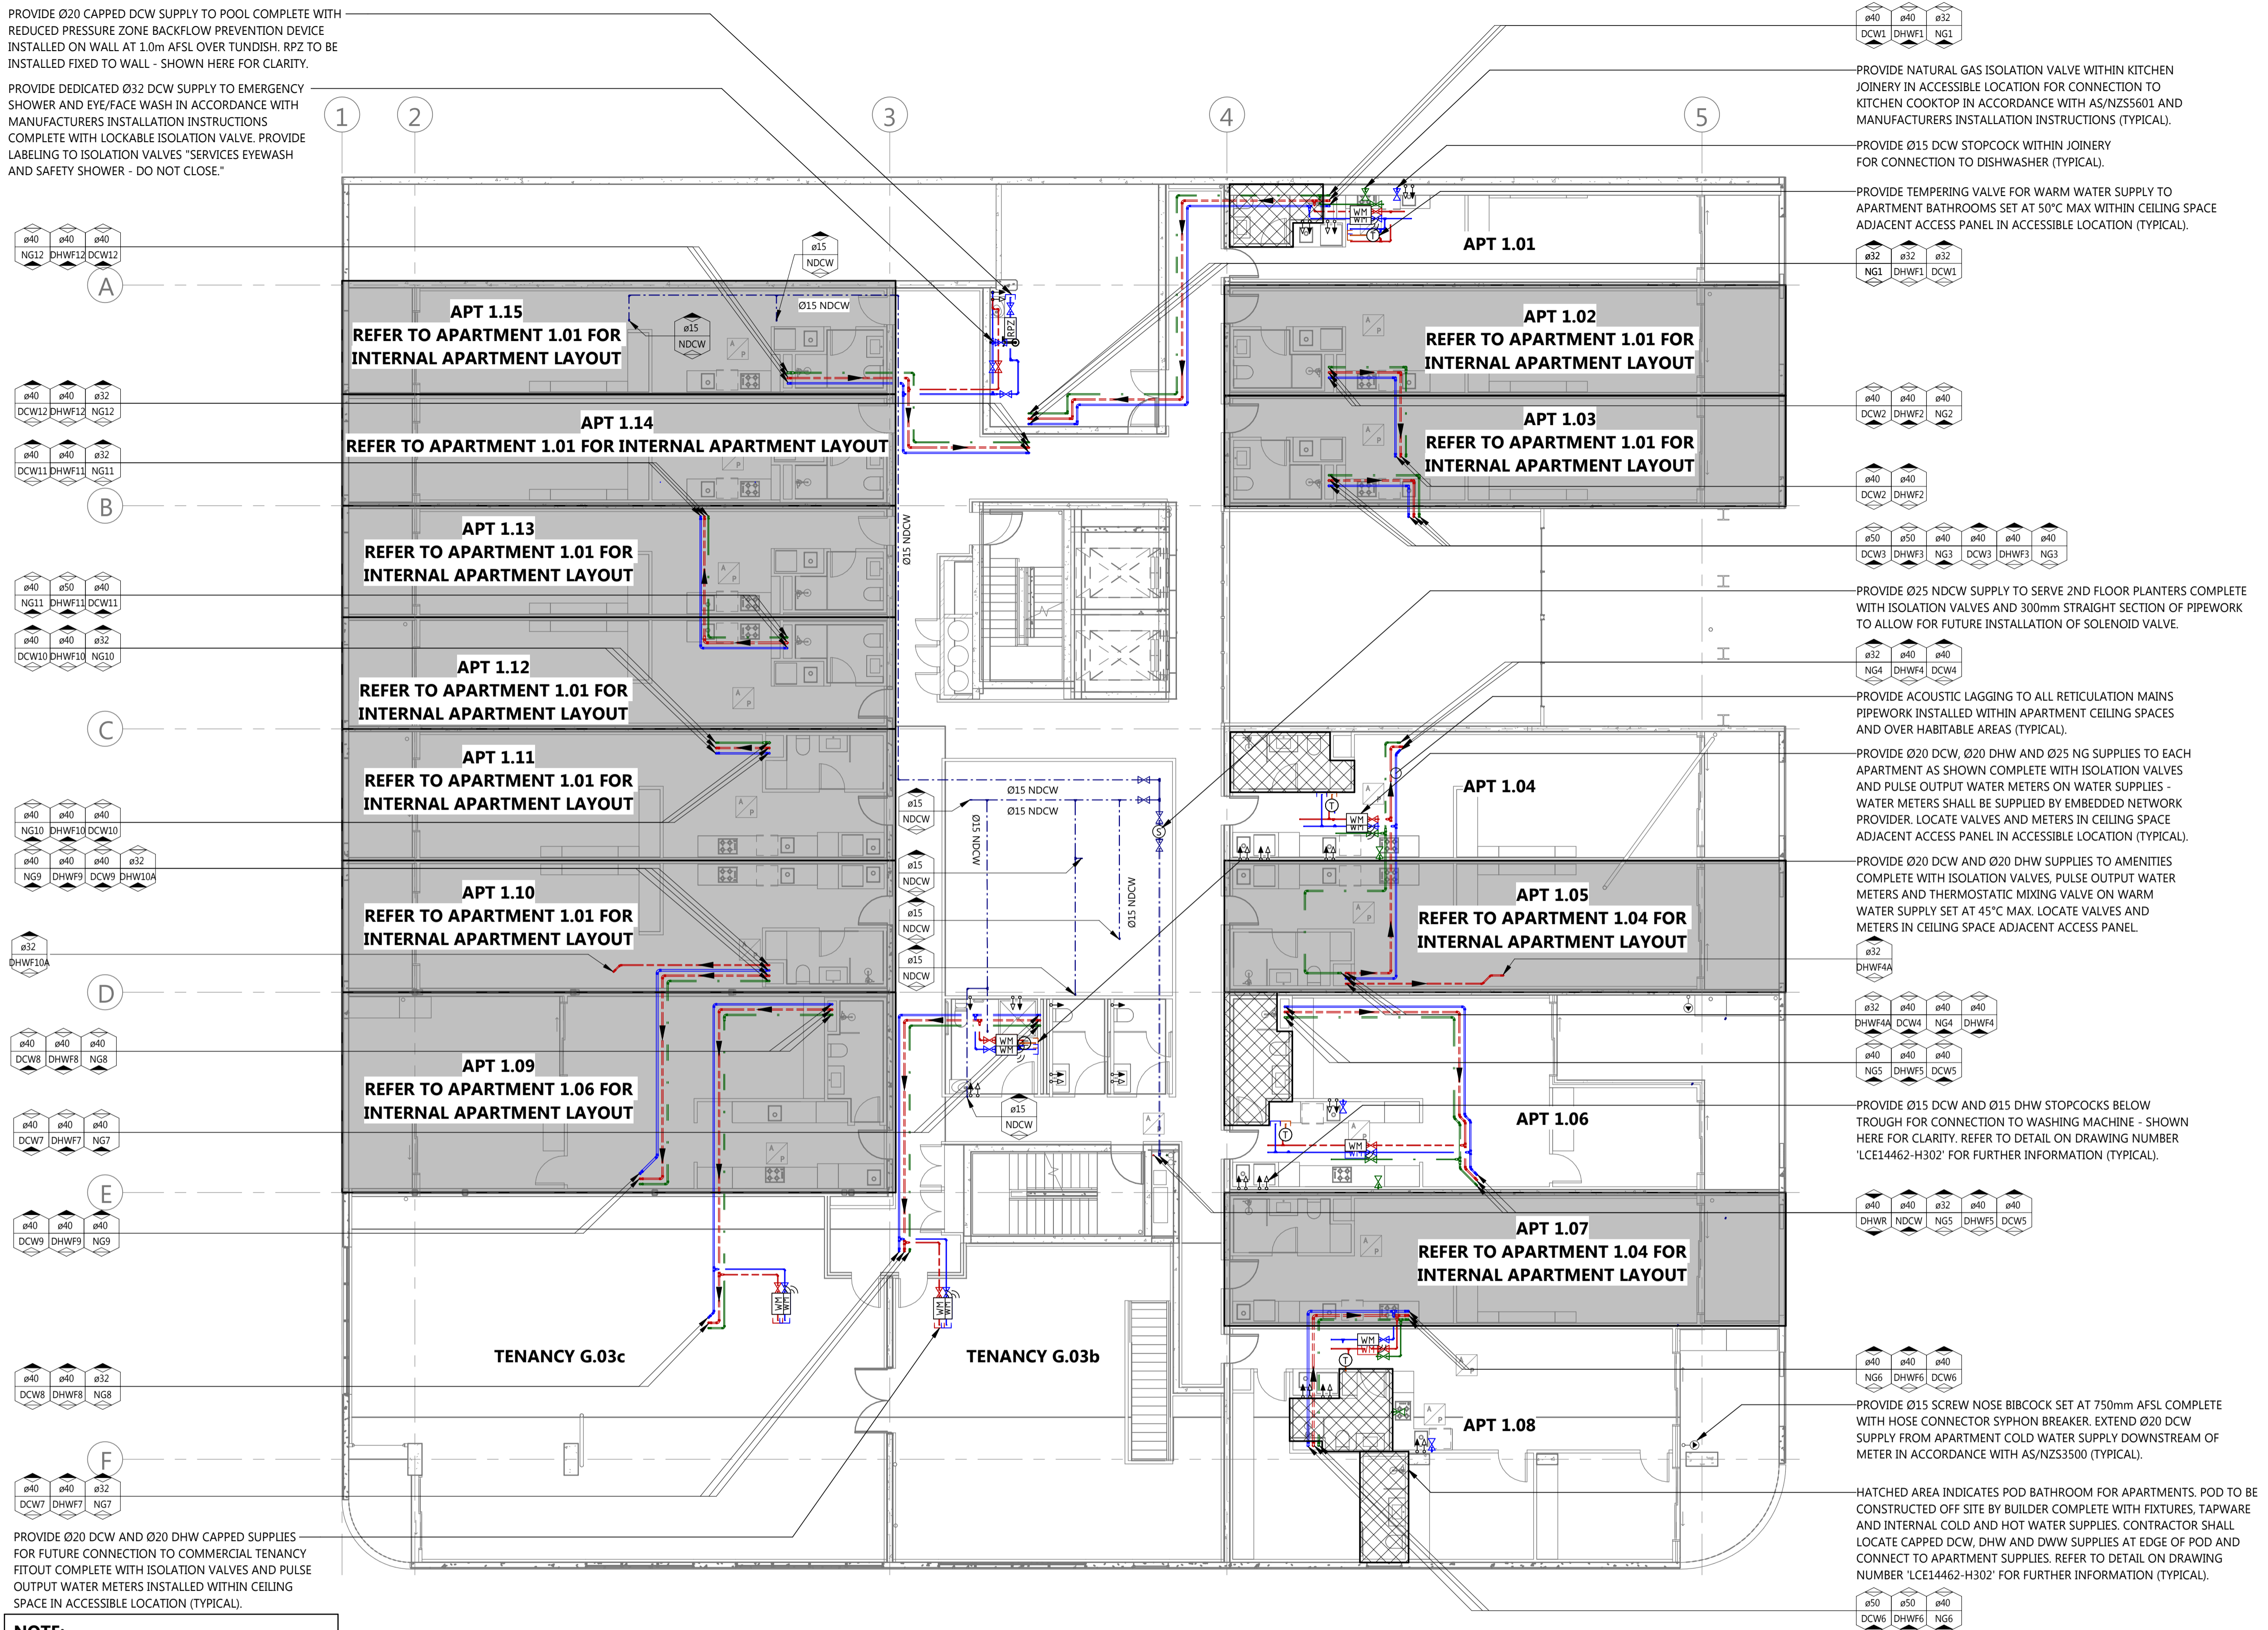

T1	TENDER ISSUE	23.05.19	KR
REV N	DESCRIPTION	DATE	CHK'D

# TENDER ISSUE



**TO BE PRINTED IN COLOUR**




GEMMA | LEA  
DESIGN STUDIO

 **LUCID**  
CONSULTING AUSTRALIA  
Level 3/169, Pirie St Adelaide SA 5000  
Phone: (08) 8407 9700  
Email: [adelaide@lucidconsulting.com.au](mailto:adelaide@lucidconsulting.com.au)

PROJECT  
HYDE PARK PLACE  
248 UNLEY ROAD, HYDE PARK  
HYDRAULIC SERVICES

---

DRAWING  
1ST FLOOR WATER AND GAS RETICULATION  
ARRANGEMENT



NOT FOR CONSTRUCTION PURPOSES UNLESS STAMPED FOR CONSTRUCTION. VERIFY DIMENSIONS AND LEVELS ON SITE BEFORE SETTING OUT. DO NOT SCALE. REFER TO FIGURED DIMENSIONS - IN mm UNLESS OTHERWISE STATED.

Scale	Design: JZ	No. in Set	Date
1 : 100	Drawn: JZ	15 of 25	MAY 2019
	Review: KR		
Orig. Size	Drawing no.		Revision
A1	LCE14462-H210		T1