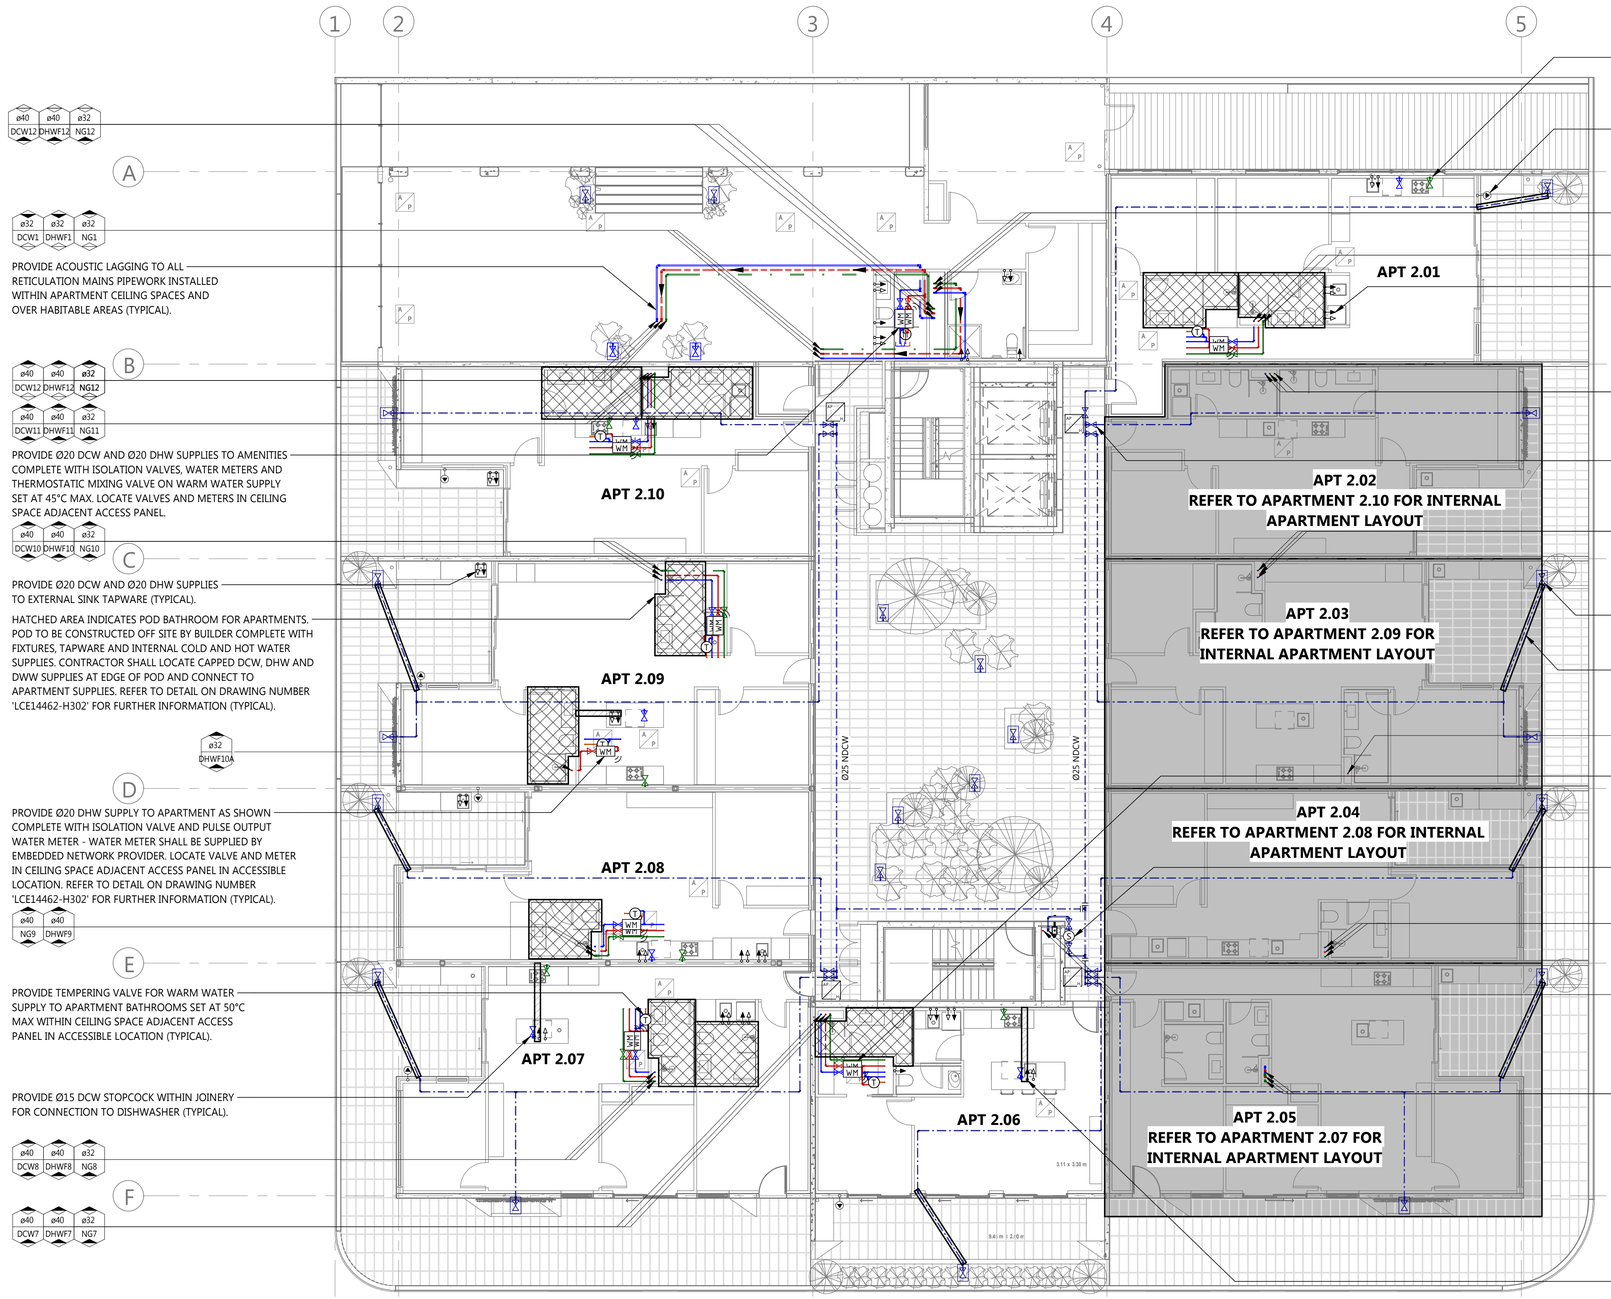

NOTE:
PROVIDE PRESSURE REDUCING VALVES TO INCOMING COLD WATER AND HOT WATER SUPPLIES TO APARTMENTS AND BASE BUILDING AREAS AS REQUIRED TO ENSURE MAXIMUM SUPPLY PRESSURE DOES NOT EXCEED 500kPa. REFER TO SCHEMATIC ON DRAWING NUMBER 'LCE14462-H301' FOR FURTHER INFORMATION - NOT SHOWN FOR CLARITY.

REV'N	DESCRIPTION	DATE	CHK'D
T1	TENDER ISSUE	23.05.19	KR

TENDER ISSUE

1 0.5 0 0.5 1 2 3 4 5 m
SCALEBAR 1:100

TO BE PRINTED IN COLOUR
THE PURPOSE OF THIS DOCUMENT IS INTENDED TO BE VIEWED OR PRINTED IN COLOUR FOR THE FULL EXTENT OF THE SCOPE OF WORKS TO BE SHOWN.

© Copyright Lucid Consulting Australia
23/05/2019 11:56:20 AM

CITIFY bfc GEMMA | LEA DESIGN STUDIO

LUCID CONSULTING AUSTRALIA
Level 3/169, Pirie St Adelaide SA 5000
Phone: (08) 8407 9700
Email: adelaide@lucidconsulting.com.au

PROJECT
HYDE PARK PLACE
248 UNLEY ROAD, HYDE PARK
HYDRAULIC SERVICES

DRAWING
2ND FLOOR WATER AND GAS RETICULATION ARRANGEMENT

NOT FOR CONSTRUCTION PURPOSES UNLESS STAMPED FOR CONSTRUCTION. VERIFY DIMENSIONS AND LEVELS ON SITE BEFORE SETTING OUT. DO NOT SCALE. REFER TO FIGURED DIMENSIONS - IN mm UNLESS OTHERWISE STATED.

Scale	Design: JZ	No. in Set	Date
1 : 100	Drawn: JZ	16 of 25	MAY 2019
	Review: KR		
Orig. Size	Drawing no.		Revision
A1	LCE14462-H211		T1