

CAR PARK SUPPLY AIR DUCTWORK EXPOSED AND RETICULATING ALONG WESTERN WALL AT HIGH LEVEL TO MAINTAIN 2100mm CLEARANCE. AIR SUPPLIED TO CAR PARK VIA EGGRATE GRILLES IN SIDE OF DUCT.

CAR PARK EXHAUST DUCTWORK TO RISE IN LOCATION ALIGNING WITH FIRE RATED RISER IN GROUND FLOOR TENANCY ABOVE.


CAR PARK EXHAUST DUCTWORK TO MAINTAIN 2100mm CLEARANCE IN BASEMENT CAR PARK, TYPICAL.

CARBON MONOXIDE MONITORING STATION.

CARBON MONOXIDE SENSOR TO BE CONNECTED WITH CAR PARK EXHAUST AND MAKE UP AIR SYSTEMS, TYPICAL.

EGGRATE TYPE GRILLES TO BE MOUNTED IN SIDE OF DUCT FOR CAR PARK EXHAUST AND SUPPLY AIR, TYPICAL.

TUNDISH IN BASEMENT TO PROVIDE GROUND FLOOR CONDENSING UNITS WITH CONDENSATE DRAINAGE. TUNDISH TO BE PROVIDED BY HYDRAULIC SERVICES, TYPICAL.

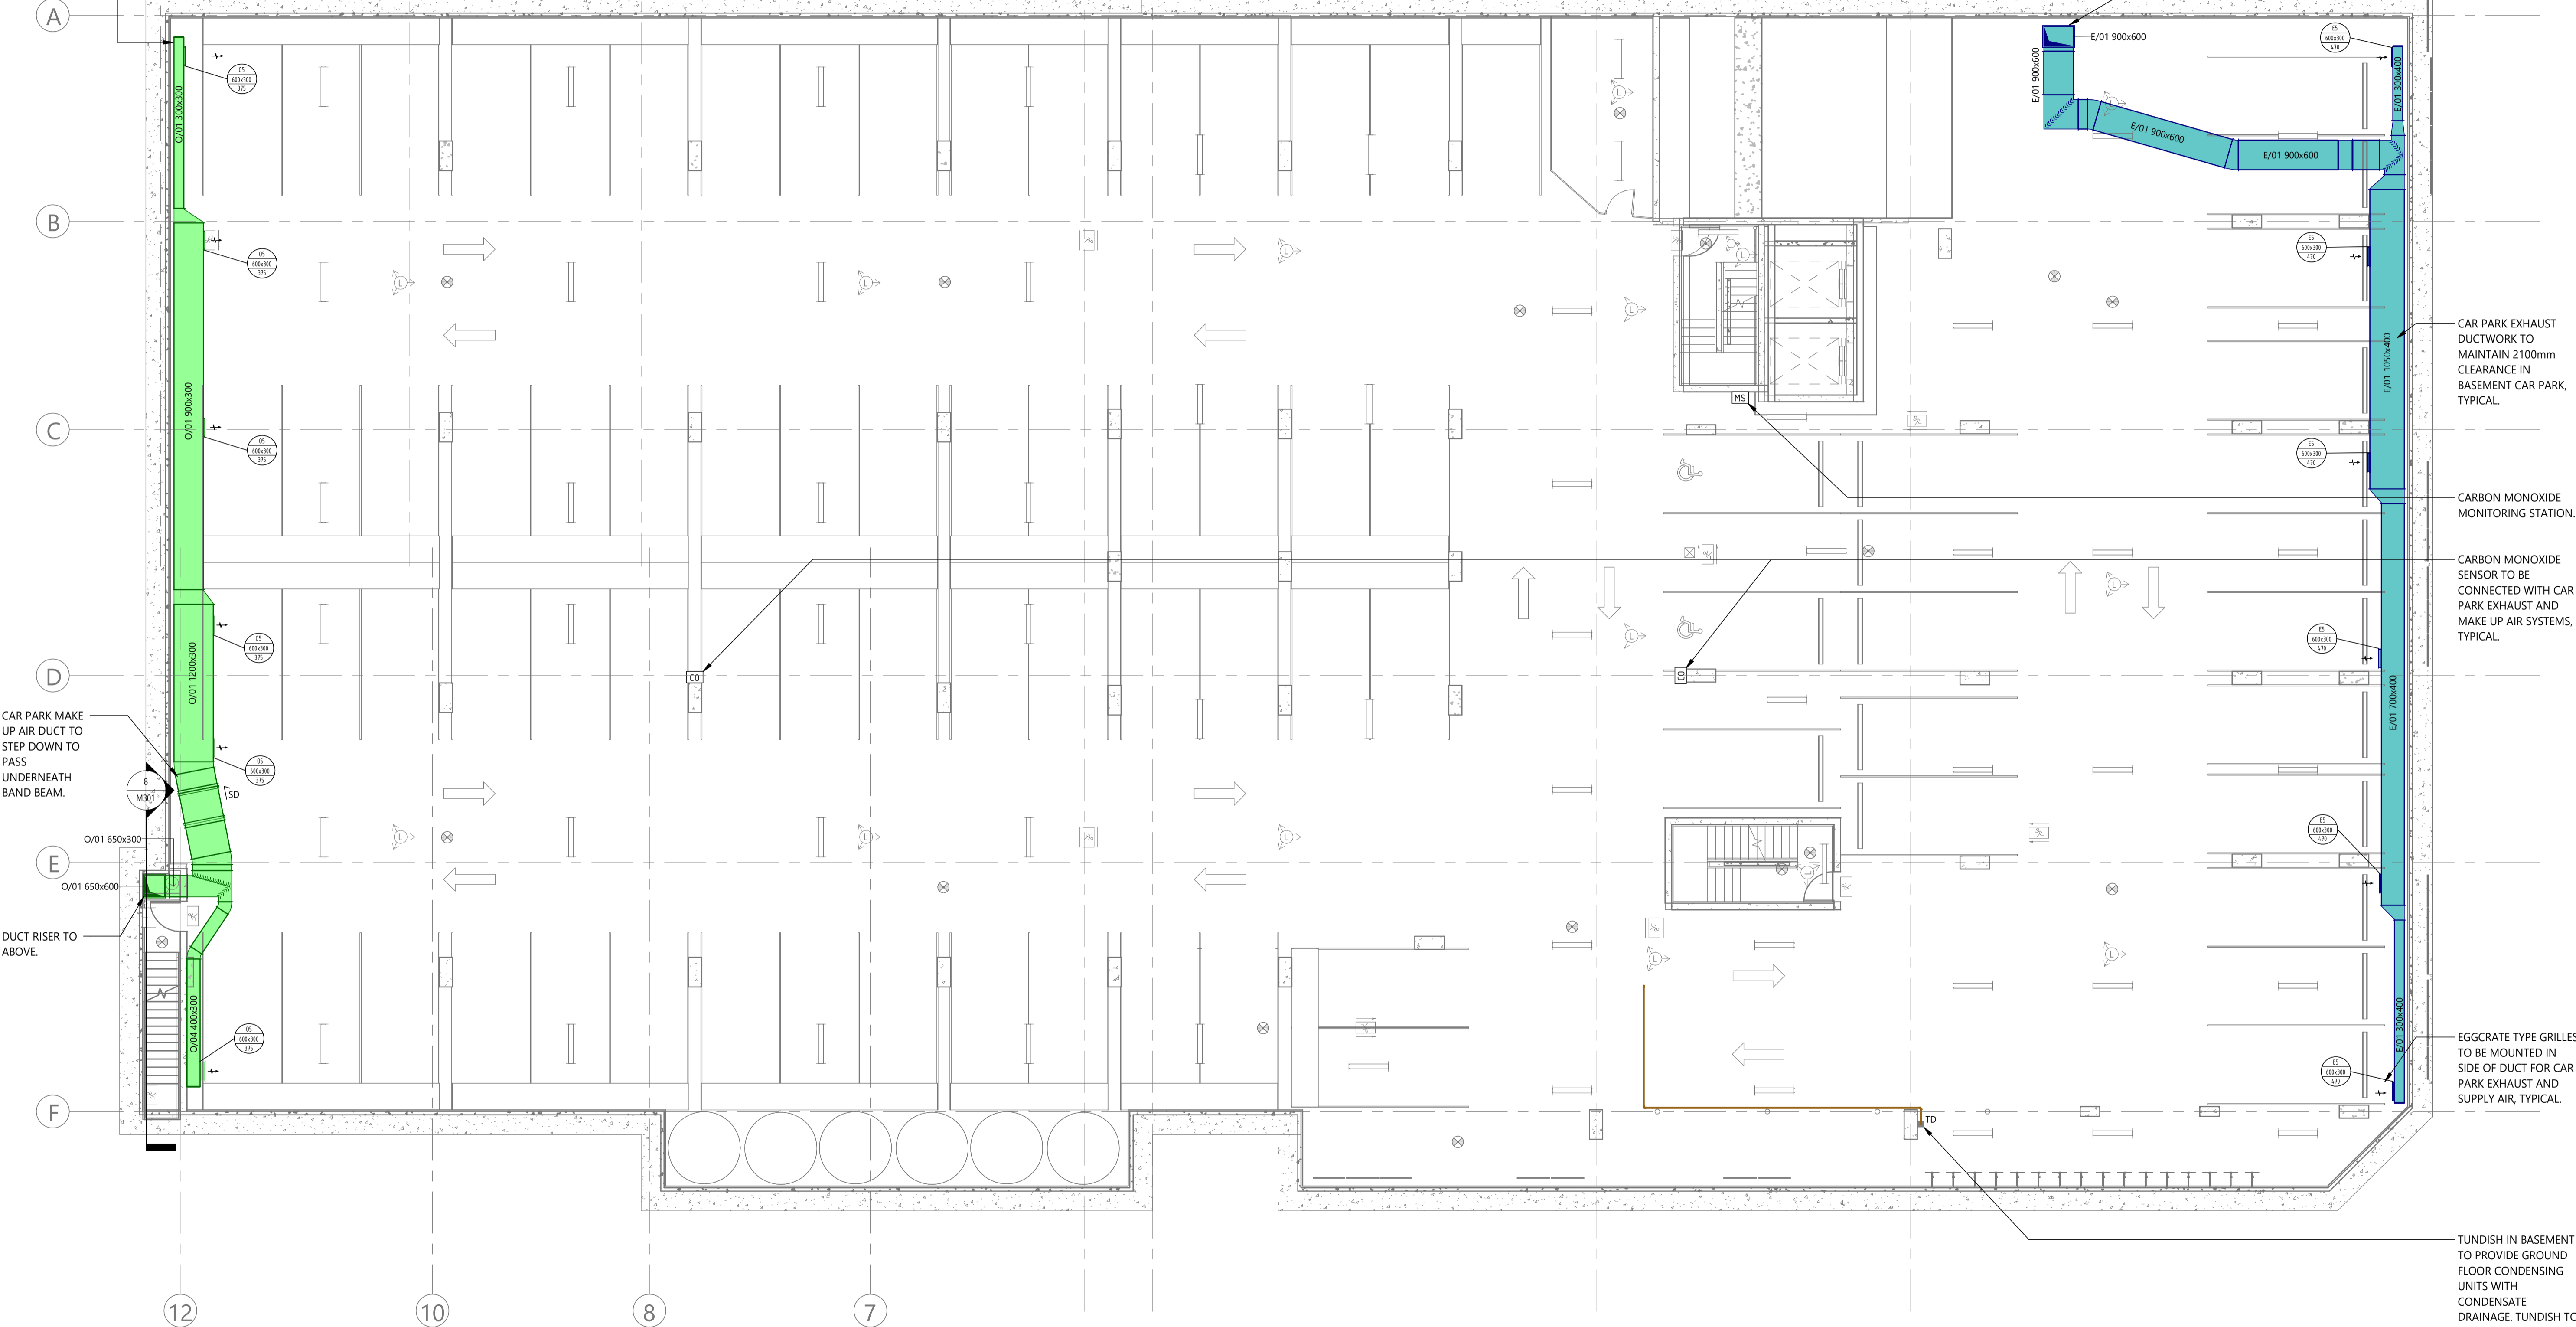


T1	TENDER ISSUE	23.05.19	TR
REV	DESCRIPTION	DATE	CHKD
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			

TENDER ISSUE

1 0.5 0 0.5 1 2 3 4 5 m
SCALEBAR 1:100


TO BE PRINTED IN COLOUR
THE PURPOSE OF THIS DOCUMENT IS INTENDED TO BE VIEWED OR PRINTED IN COLOUR FOR THE FULL EXTENT OF THE SCOPE OF WORKS TO BE SHOWN.

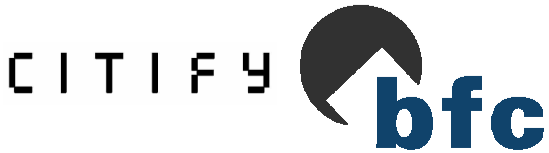

LUCID
CONSULTING AUSTRALIA
Level 3/169, Pirie St Adelaide SA 5000
Phone: (08) 8407 9700
Email: adelaide@lucidconsulting.com.au

PROJECT
HYDE PARK PLACE
248 UNLEY ROAD, HYDE PARK
MECHANICAL SERVICES

DRAWING
BASEMENT MECHANICAL SERVICES ARRANGEMENT



NOT FOR CONSTRUCTION PURPOSES UNLESS STAMPED FOR CONSTRUCTION. VERIFY DIMENSIONS AND LEVELS ON SITE BEFORE SETTING OUT. DO NOT SCALE. REFER TO FIGURED DIMENSIONS - IN mm UNLESS OTHERWISE STATED.

Scale 1:100 Design: JD/TC Drawn: JD Review: TR No. in Set 4 of 15 Date MAY 2019

Orig. Size Drawing no. Revision
A1 LCE14462-M200 T1