

NOTES:

1. Unless shown on this plan bracing shall be in accordance with True Steel Frames (TSF) details.

2. All external walls to be load bearing unless noted otherwise (u.n.o.)

3. Unless specified on this drawing, all brick lintels shall be by others.

4. Where blocking between adjacent beam / joist is noted as being required in member schedule, provide C9075 stud or ceiling batten material @ 1500 crs max, 2,10g tek screws each end.

5. Do not scale this drawing. All dimension, etc. to be taken from architectural plans, and where structural steel is required to be checked on site prior to fabrication.
6. All steelwork to be coated using inorganic zinc silicate, with exposed members to additionally be painted using Solver Duraguard (or similar).

7. All welds to be 6mm CFW (u.n.o.)

8. All hot rolled sections to be Grade 300 Plus. All SHS members to be G350 (min).

9. Bottom plates welded to beams / risers: weld 300mm each end, then miss 100mm, hit 100mm.

10. Provide 10mm web stiffener to beams where supporting columns/beams over.

LEGEND

- ▲

1/C9075 wall stud
- ✕

2/C9075 wall stud ( ㄟ )
- 2/C9075 boxed studs ( ㄟ )
- Boxed C-sections
- ▨

Internal steel-framed load bearing wall
- ▤

Stair / plumbing voids
- └



Wet areas (floor joists set down to suit)
- 1.8

5.0mm thick Hardie Brace as per manufacturers specification. (not shown to scale on plan)
- 1.8


30x1.0mm thick metal Strap Cross-Brace as per TSF details (not shown to scale on plan.)
- PI

Sheet-Brace as per TSF details.
- K

K-Brace as per TSF details.

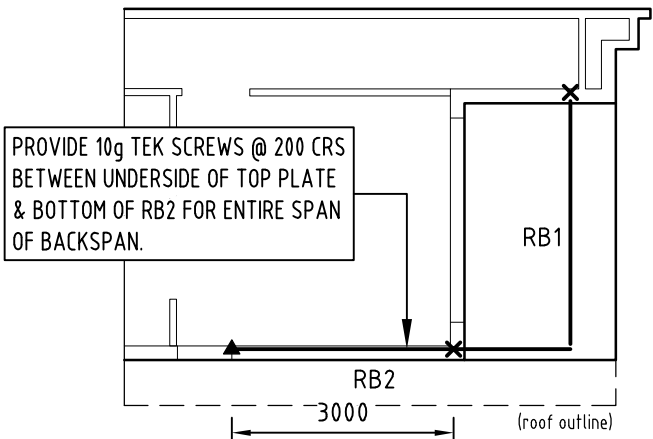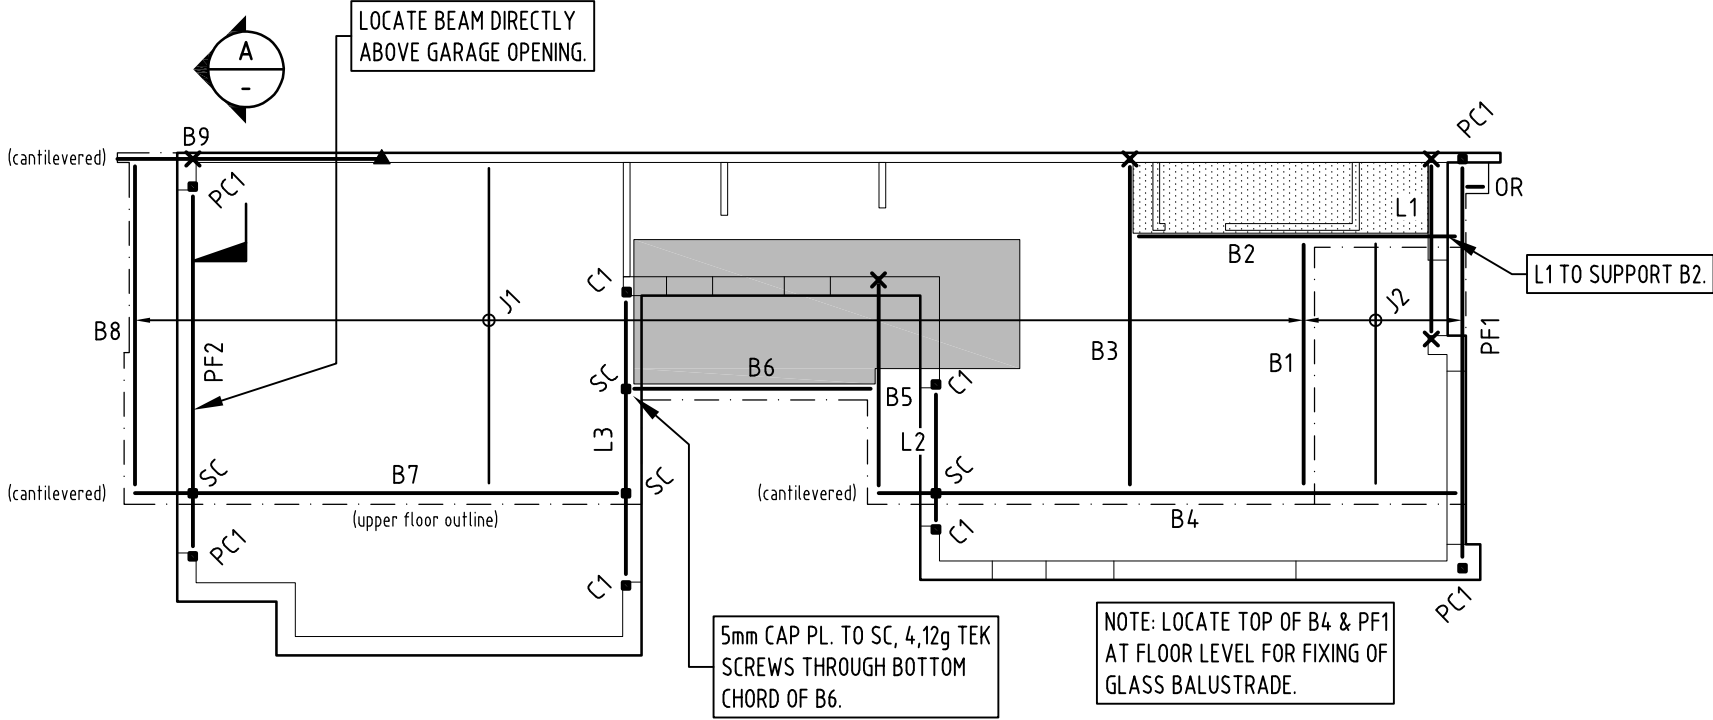

PART ROOF FRAMING PLAN

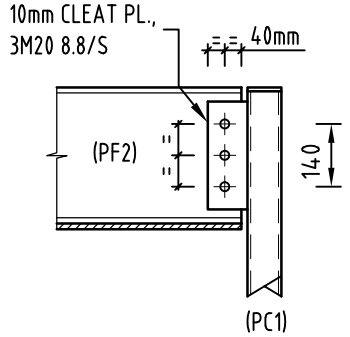

SECTION A  
SCALE: N.T.S.

TYPICAL CONNECTION DETAIL OF PORTAL FRAME

MEMBER SCHEDULE

MARK	SIZE	REMARKS
J1	TSF4575 @ 600 CRS MAX	STANDARD TSF JOISTS. REFER TO TSF DETAILS.
J2	TSF4075 @ 450 CRS MAX	STANDARD TSF JOISTS. REFER TO TSF DETAILS.
B1	1/TSF4510	REFER TO TSF DETAILS SK10. / 1.5mm ANGLE BOTH SIDES, 4,12g TEK SCREWS EACH LEG TO B2. / 8mm CLEAT, 3M12 8.8/S TO B4.
B2	2/C25024 □	1.5mm ANGLE BOTH SIDES, 4,12g TEK SCREWS EACH LEG TO B3. / 8mm CLEAT PL., 2M12 8.8/S TO PF1.
B3	2/C25019 □	8m CLEAT PL., 3M12 8.8/S TO B4. / PROVIDE BLOCKING AS PER NOTE 4.
B4	360 UB 45	10mm CLEAT PL., 3M16 8.8/S ONE END. / 10mm CAP PL., 4M16 8.8/S TO CANTILEVERED END.
B5	2/TSF4575	REFER TO DOUBLE JOIST DETAIL JD1. / 1.5mm ANGLE BOTH SIDES, 4,10g TEK SCREWS EACH LEG TO B4.
B6	2/TSF4575	REFER TO DOUBLE JOIST DETAIL JD1. / 1.5mm ANGLE BOTH SIDES, 4,10g TEK SCREWS EACH LEG TO B5.
B7	310 UB 40	10mm CLEAT PL., 3M16 8.8/S ONE END. / 10mm CAP PL., 4M16 8.8/S TO CANTILEVERED END.
B8	2/TSF4575	REFER TO DOUBLE JOIST DETAIL JD1. / 1.5mm ANGLE BOTH SIDES, 5,10g TEK SCREWS EACH LEG TO B7 & B9. / PROVIDE BLOCKING AS PER NOTE 4.
B9	2/TSF4575	REFER TO DOUBLE JOIST DETAIL JD1.
OR	89 x 89 x 3.5 SHS	FULLY WELDED TO PF1.
L1	2/C20019 □	
L2,L3	250 PFC 200 x 10mm PLATE	10mm CLEAT PL., 3M16 8.8/S.
RB1	2/C15015 □ (min)	1.5mm ANGLE, 6,10g TEK SCREWS EACH LEG TO RB2.
RB2	2/C20015 □	
C1	89 x 89 x 3.5 SHS	10mm BASE PLATE, 2M16 CHEMSET ANCHORS, 125mm EMBEDMENT.
SC	89 x 89 x 6.0 SHS	FULLY WELDED TO TOP FLANGE OF SUPPORTING BEAM.
PORTAL FRAME		
PF1	250 PFC	10mm CLEAT, 3M20 8.8/S. REFER TO SECTION A.
PF2	250 PFC 200 x 10mm PLATE	10mm CLEAT, 3M20 8.8/S. REFER TO SECTION A.
PC1	89 x 89 x 6.0 SHS	10mm BASE PL., 2M16 CHEMSET ANCHORS, 125mm EMBEDMENT. / FIX COLUMN TO ADJACENT WALL STUD WITH 10g TEK SCREWS @ 300 CRS VERTICALLY.

NOTE: UNLESS NOTED OTHERWISE, BRICK LINTEL BY OTHERS.

Rev.	Remark / Comment	Date
-	Issued for Approval / Construction.	14.10.2019
A	Member schedule updated. Re-issued for Approval / Construction.	22.10.2019

AUSTRUCT

Consulting Engineers

A.B.N. 90 627 866 022  
Phone: 0403 244 681  
Email: stathi@austructconsulting.com.au

TRUE STEEL FRAMES  
PROPOSED DWELLING  
FOR: COSCIA  
AT: No. 4 REDWOOD STREET, ROSTREVOR (DWELLING 2)  
FIRST FLOOR FRAMING PLAN

Design: A.N.	Scale (A3)
Drawn: A.N.	1:100
Date: OCT'19	
Job No.	Drg. / Rev.
19/177-2	ST1/A